

Connection

Architecture:

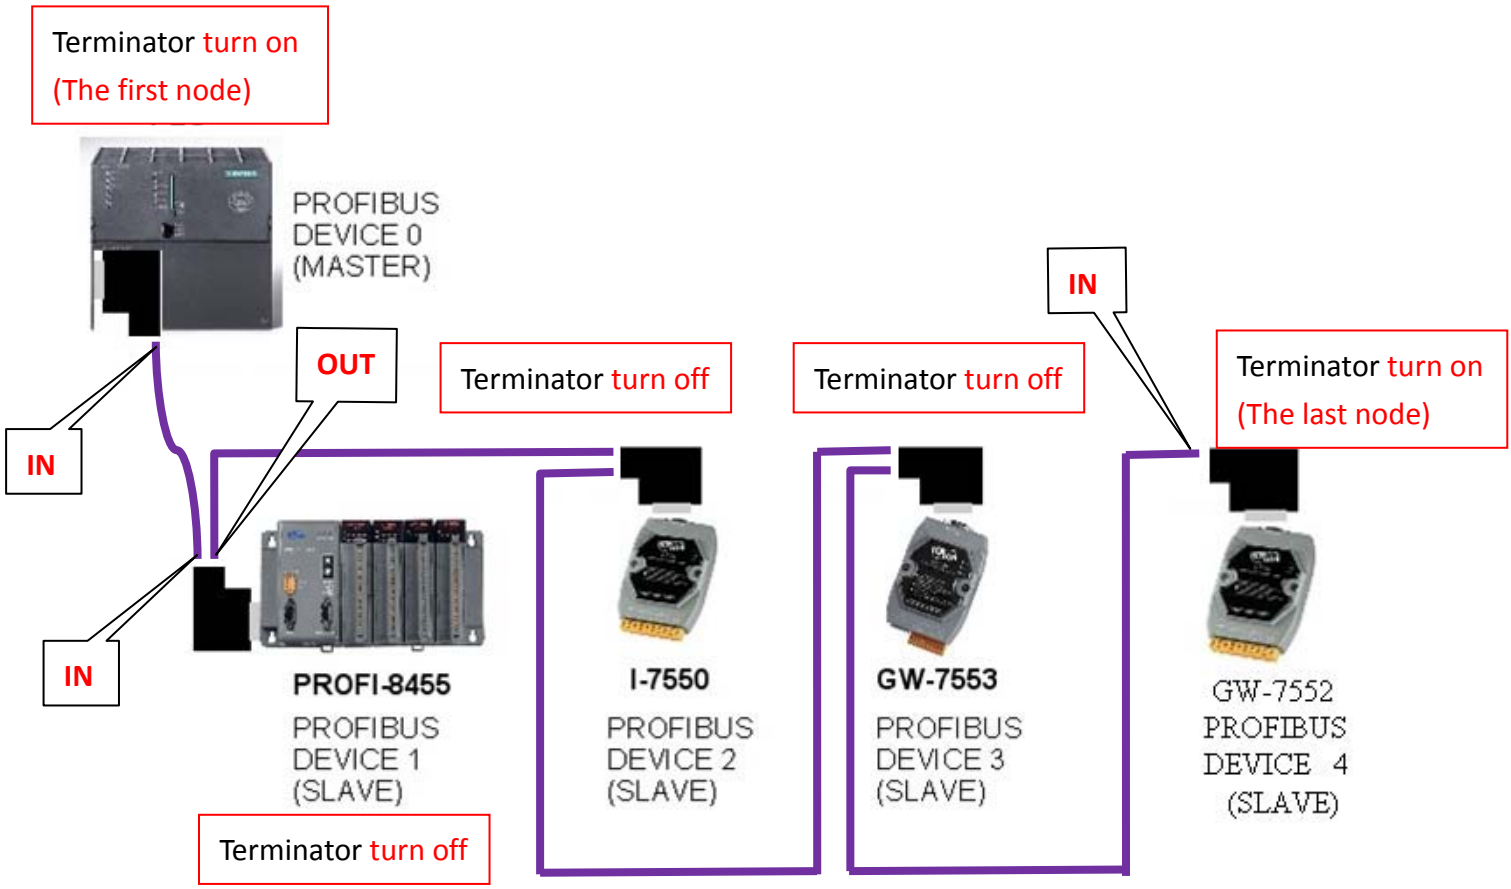

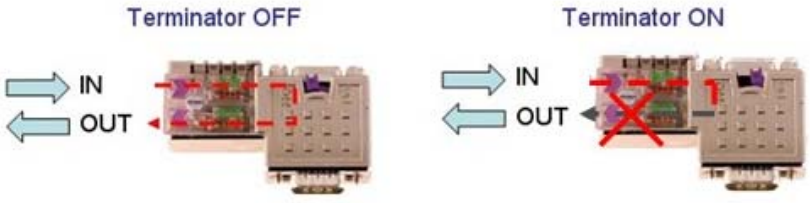


LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Description


For this architecture, the SIMATIC STEP7 and GW-7552 are terminations so that the terminators of STEP7 and GW-7552 must turn on. The terminators of GW-7553, I-7552 and PROFI-8455 must turn off. The following examples show the correct and incorrect connections.


Example 1: PLC and I-7550 are terminations and both terminators must turn on!

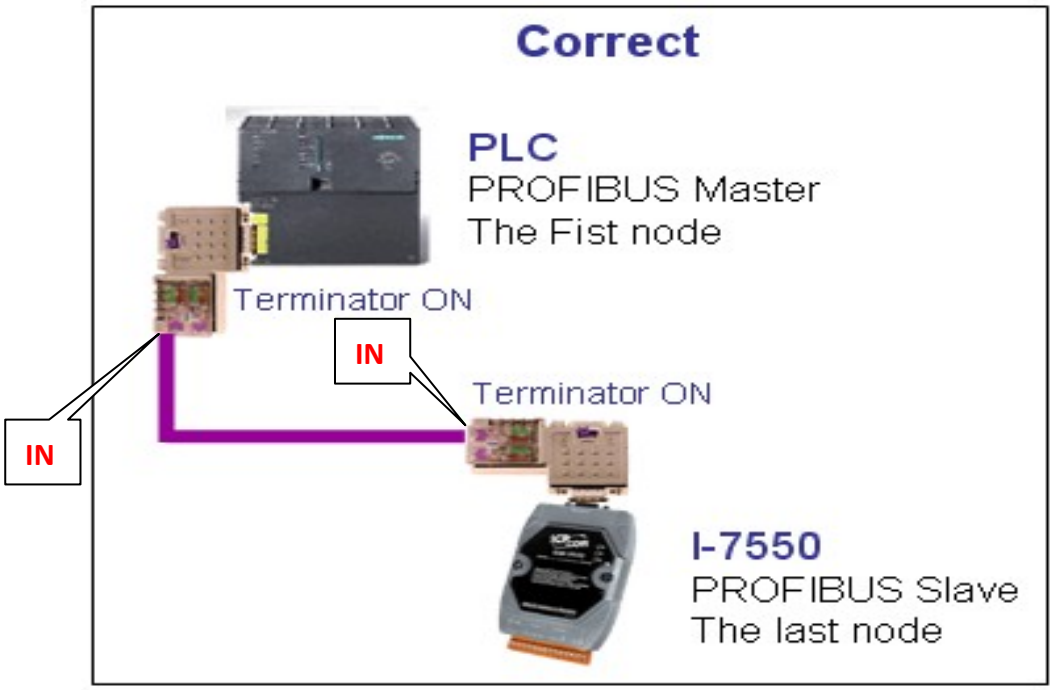


Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Example 2: There are various kinds of incorrect connections.

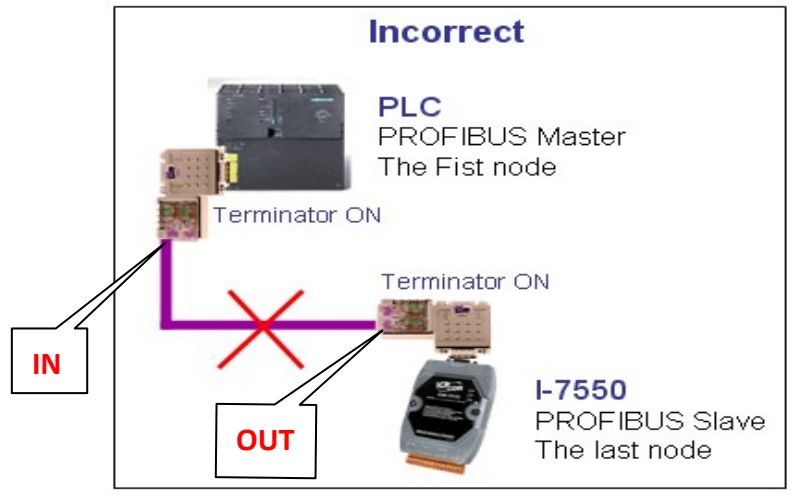

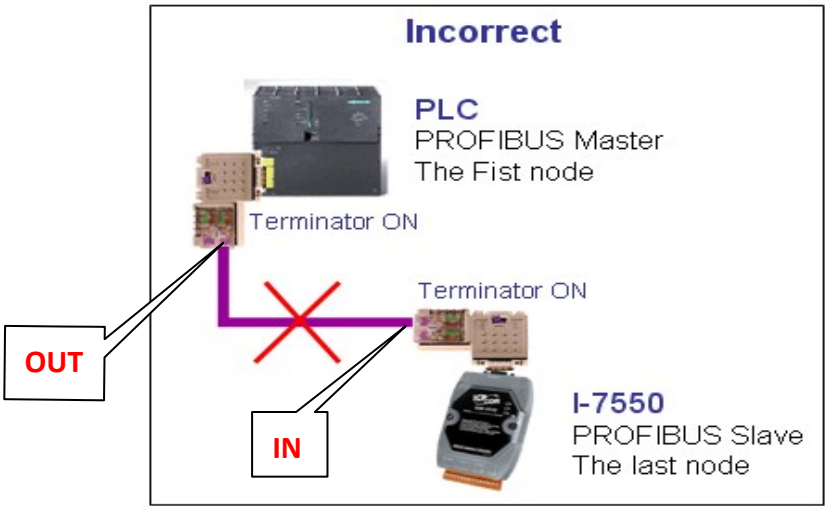

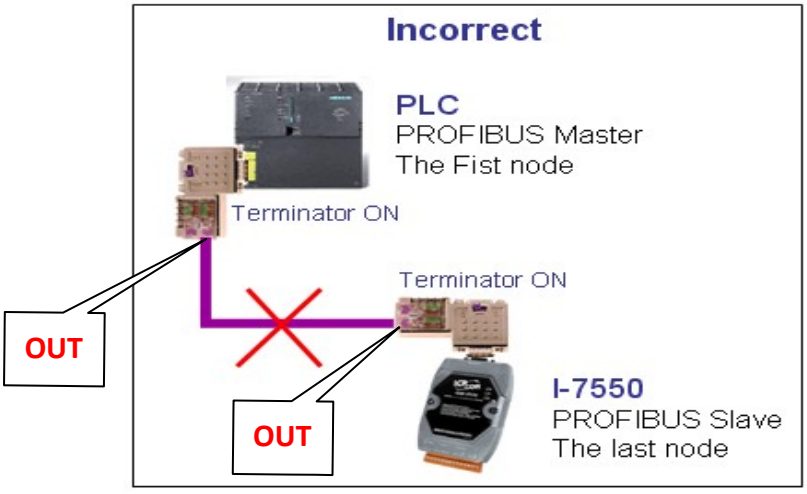

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Example 3: Correct connection

