How to update GSD file for STEP 7 ?


Step 1: Download the newest GSD file.

GW-7552(ipds0b87.GSD) at
ftp://ftp.icpdas.com/pub/cd/fieldbus_cd/profibus/gateway/gw-7552/gsd/

GW-7553(IPDS0C0D.GSD) at
ftp://ftp.icpdas.com/pub/cd/fieldbus_cd/profibus/gateway/gw-7553/gsd/


i-7550(ipds0b0d.GSD) at
ftp://ftp.icpdas.com/pub/cd/fieldbus_cd/profibus/converter/i-7550/gsd/


Step 2: Double click "**Hardware**"

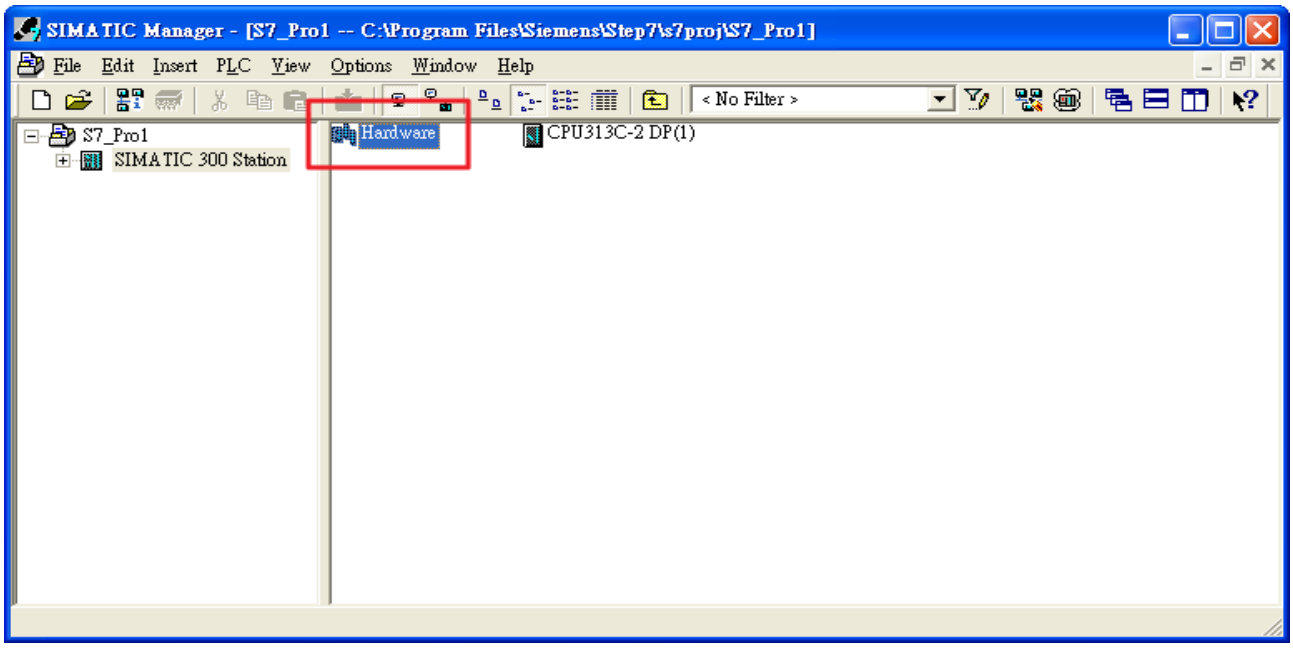

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Step 3: Delete PROFIBUS slave and then click “**station => Save**”

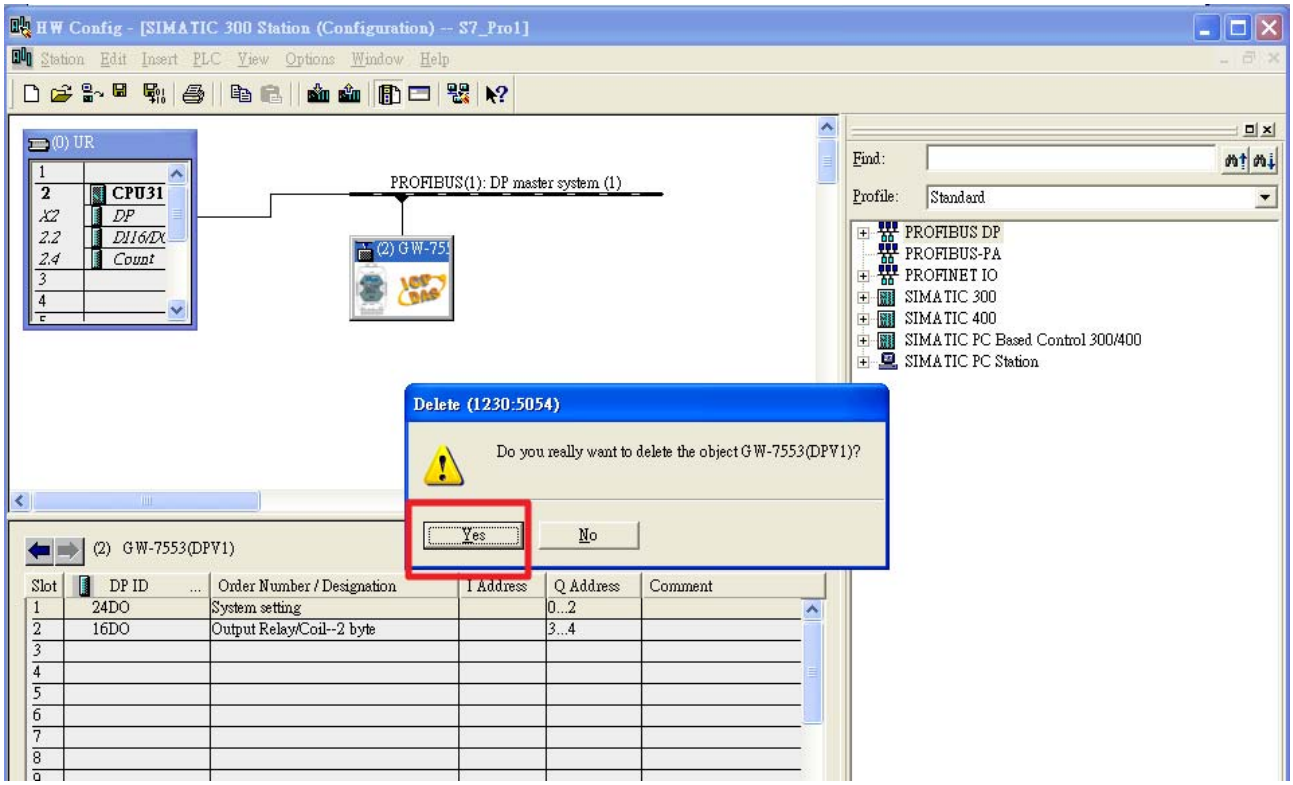

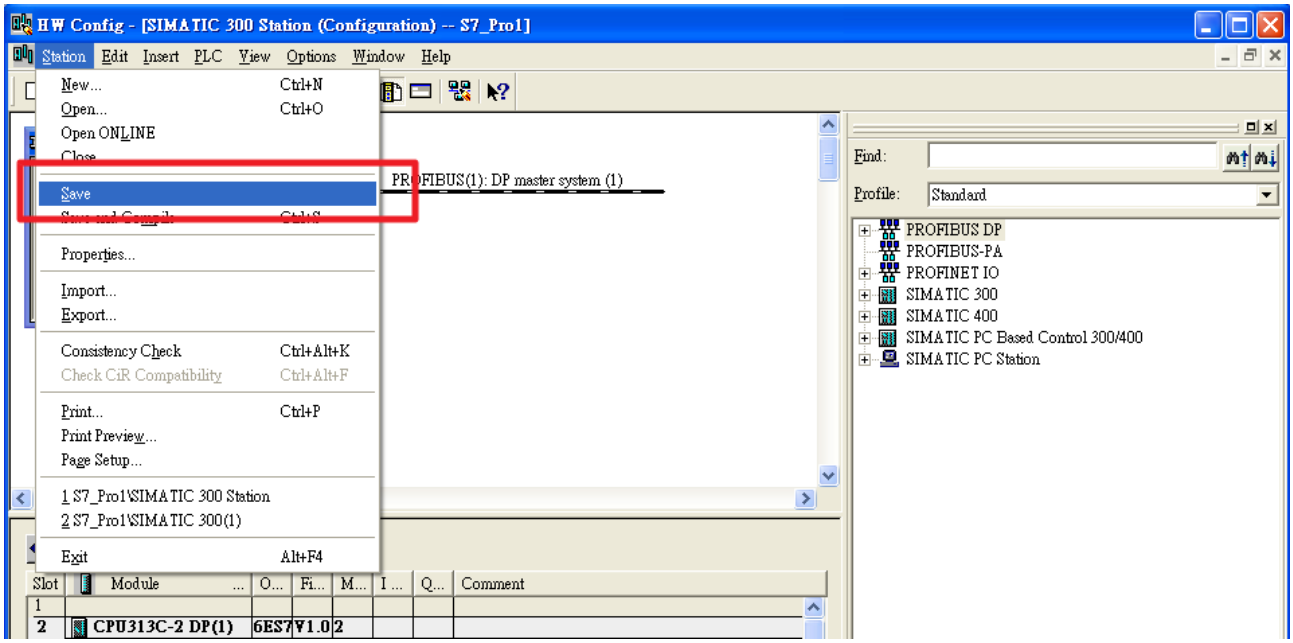

Step 4: Close “**Hardware**”


Step 5: Open “**<Drive>:\Program Files\Siemens\Step7\S7DATA\GSD**” , find “**IPDS0C0D.GSD**” and delete it.

Note:


GW-7552: ipda0b87.gsd


GW-7553: IPDS0C0D.GSD

i-7550: ipds0b0d.gsd

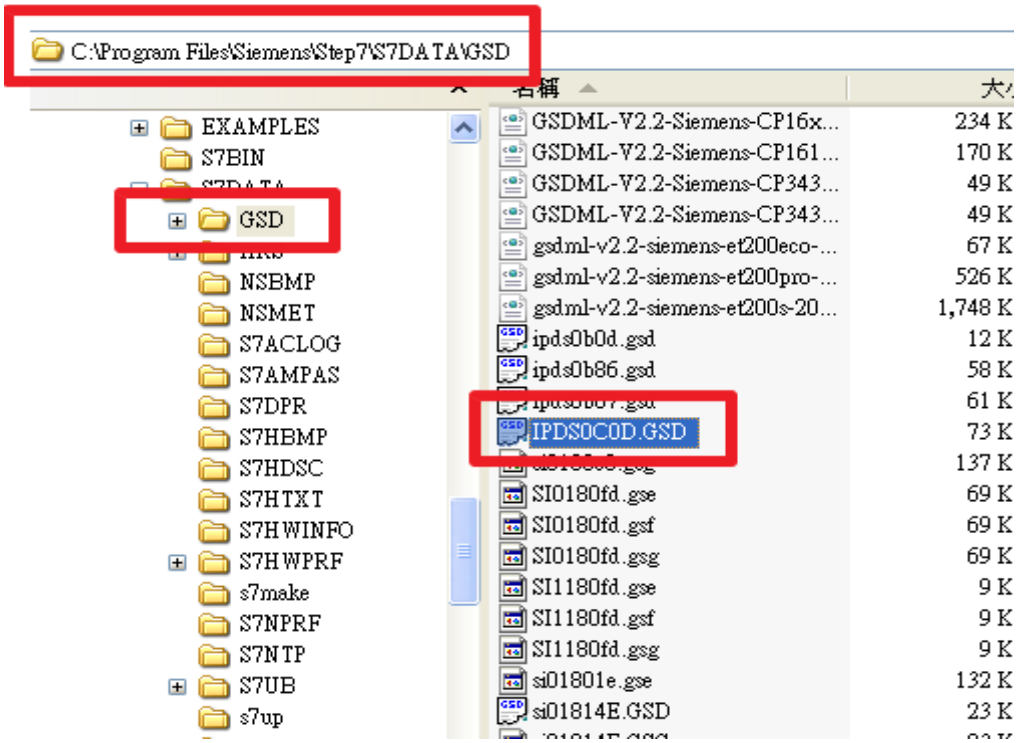


Step 6: Open “**Hardware**” and check if GW-7553(DPV1) is disappear

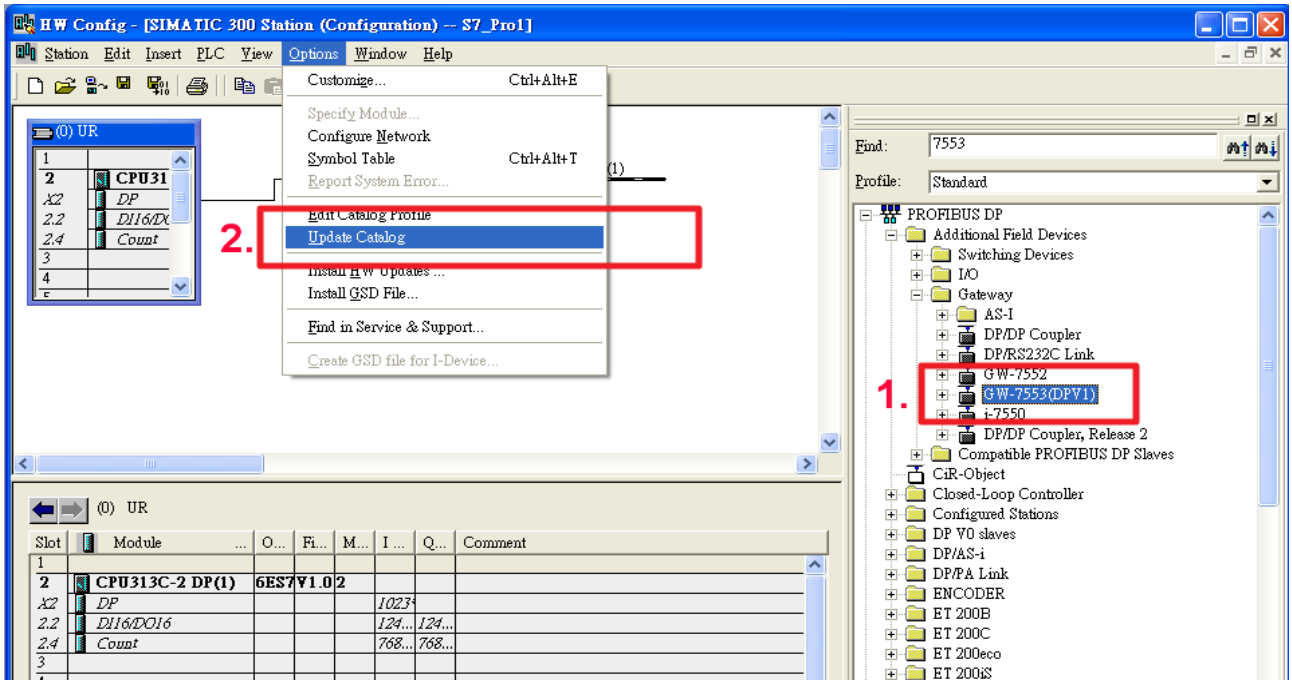


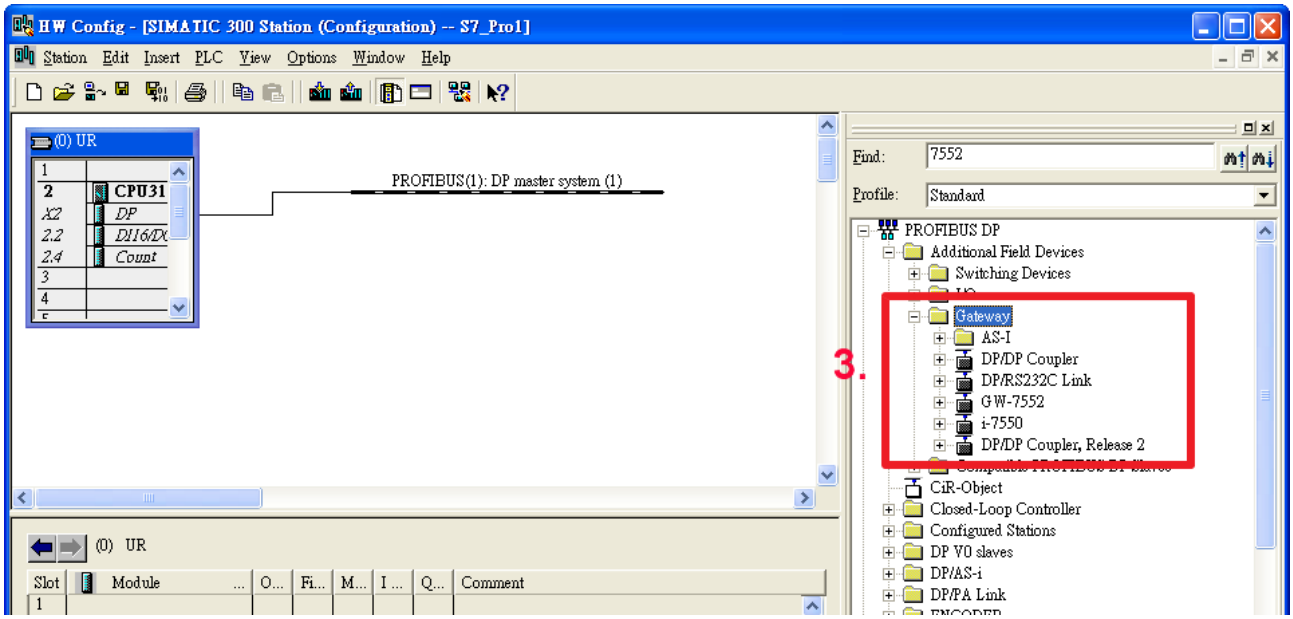


Step 7: Click option => **“Install GSD File”**

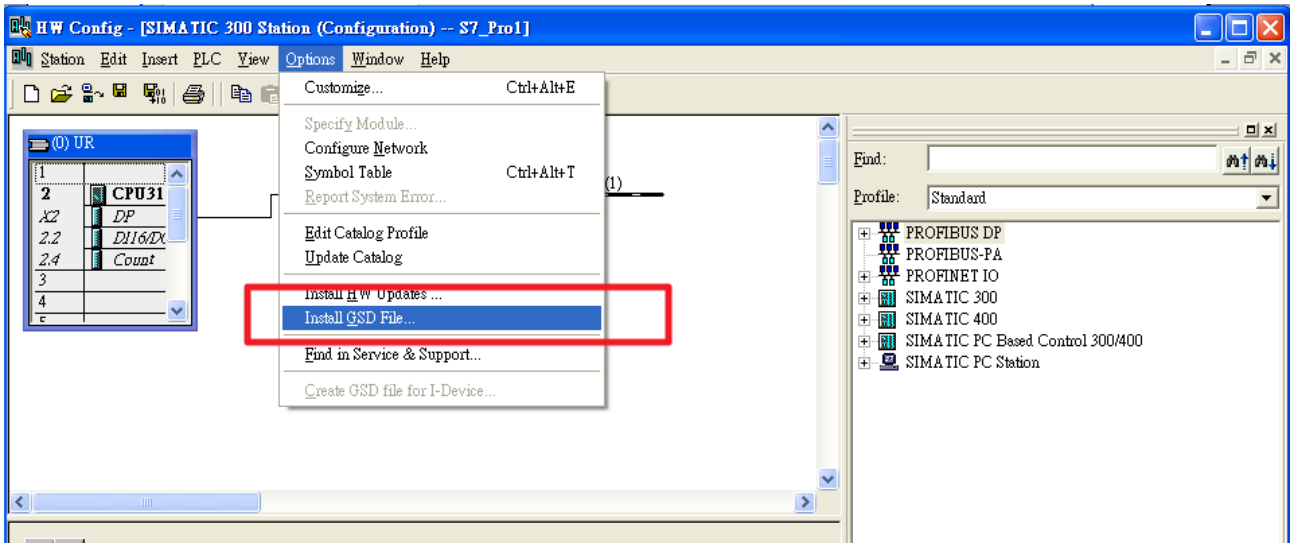

Step 8: Select “**from the directory**” and click “**Browse**”.

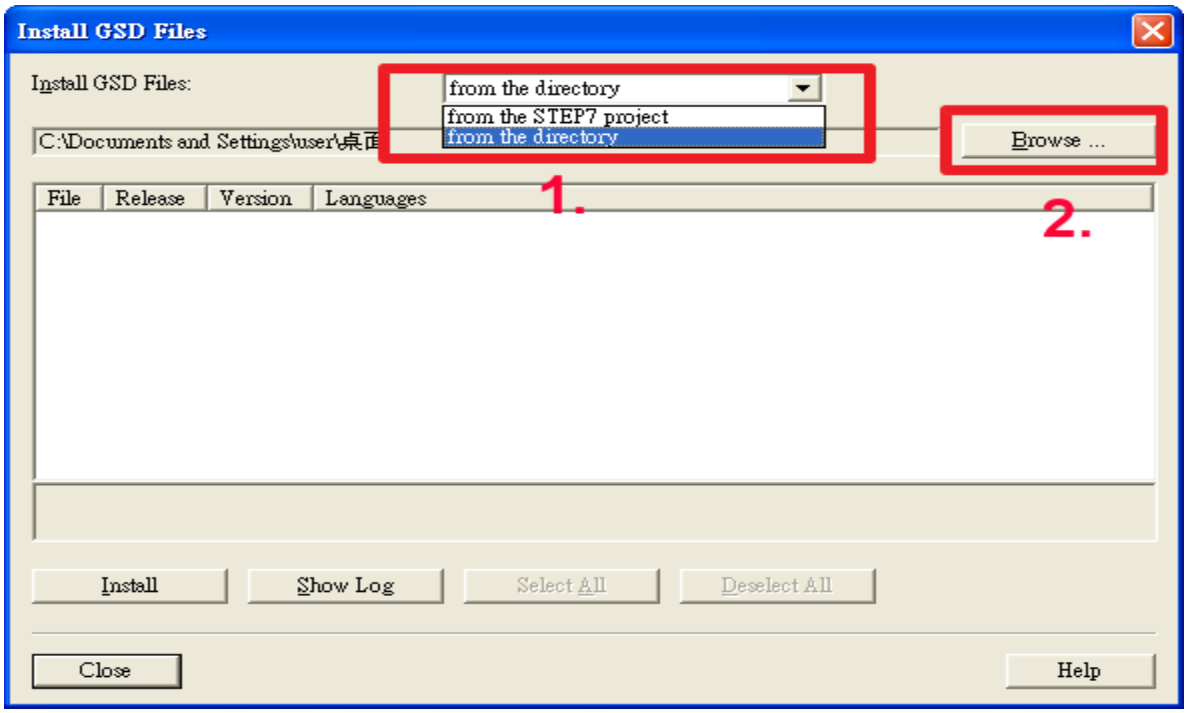

Step 9: Click “**Install**”

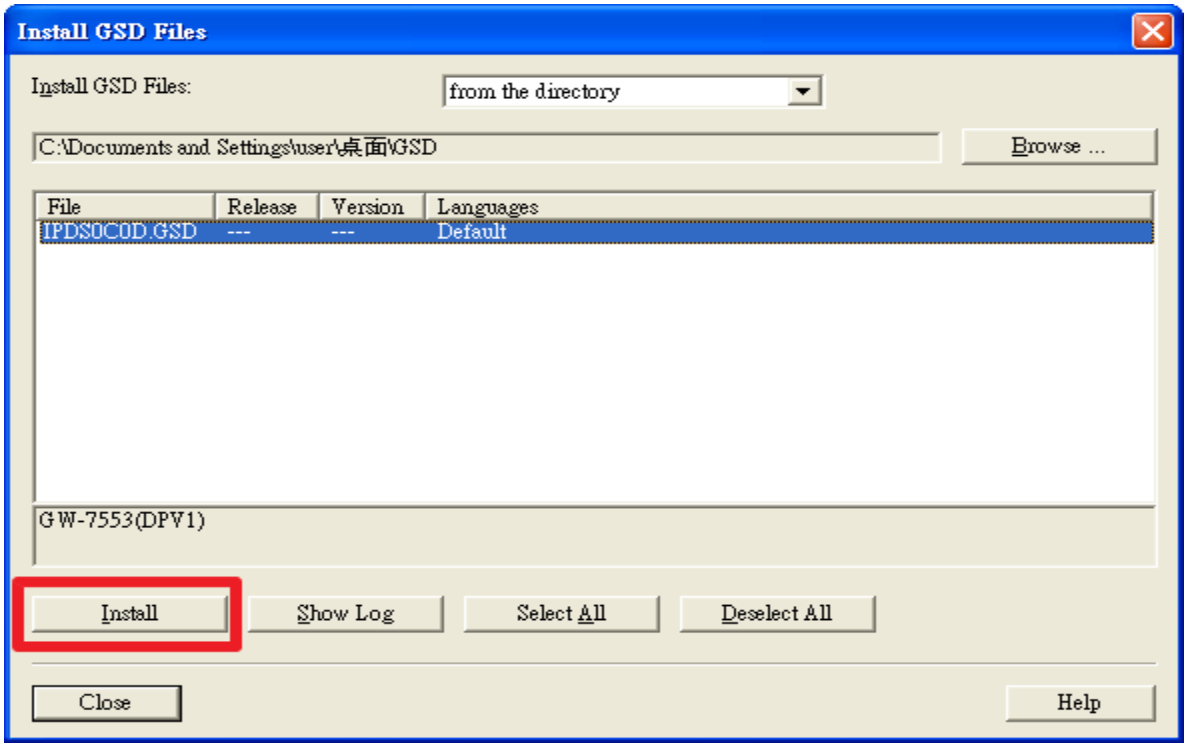

Step 10: Click “Yes” and then install OK.

