EtherDOT

User Manual

for Ethernet Module Setting Backup/Recover/Mass deploy

English Version

V1.0

2019.Sep

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Table of contents


1. Home 3
   1.1 Change Main Function Page 4
   1.2 Exit the EtherDOT 5
2. Network Setting Batch Configure 6
   2.1 How to batch several devices 7
3. Backup/Restore/Mass Configure 10
   3.1 Backup 11
   3.2 Restore 13
   3.3 Mass Configure 14

Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1. Home

This page shows the supported product and their related links.

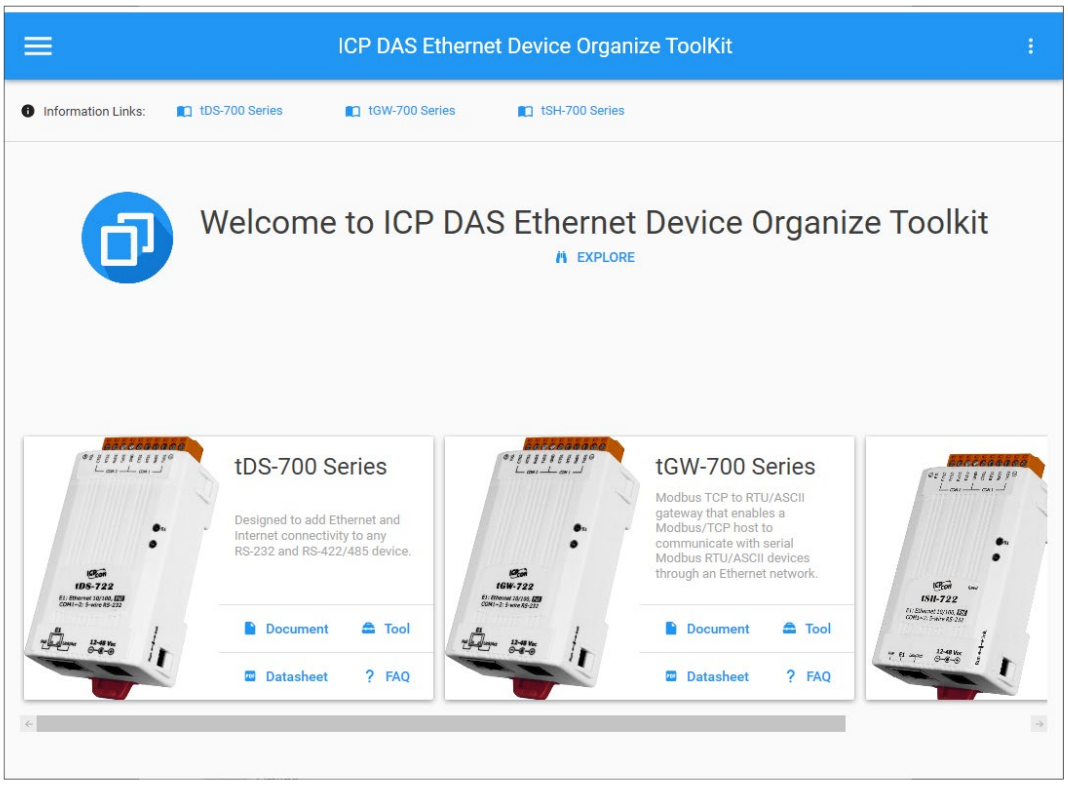

	System Menu	The support, information, setting and Exit button of EtherDOT
	EXPLORE	Menu of main function
	EXPLORE	Menu of main function
	Information Link	Product home page
	Document Link	Product related document
	Tool Link	Product related soft program
	Datasheet Link	Product datasheet
	FAQ Link	Frequently asked questions of product


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.1 Change Main Function Page

Click the EXPLORE button and the Menu will stretch out.



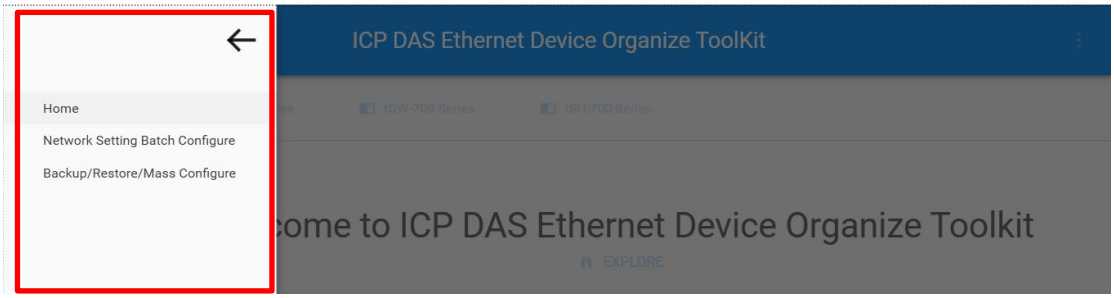


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.2 Exit the EtherDOT

Click the System Menu button and click the Exit in the Bouncing window.

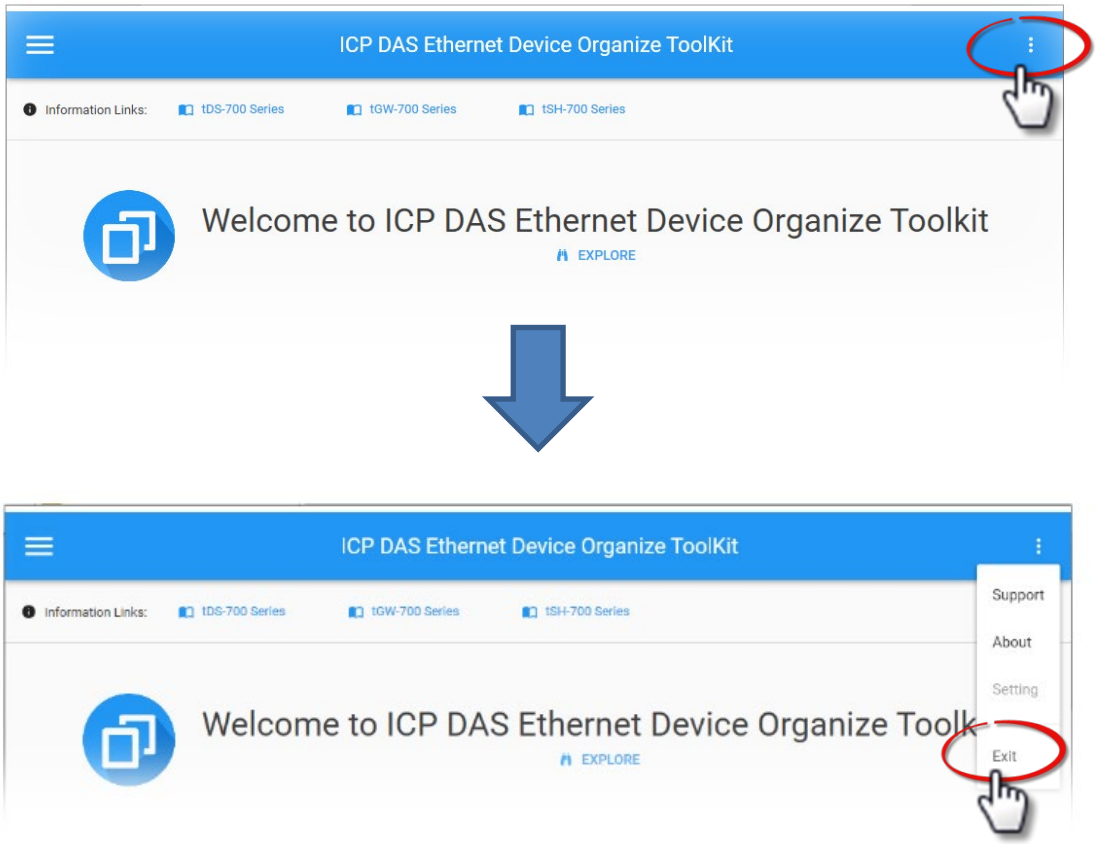


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2. Network Setting Batch Configure

This page can batch Network settings of several devices at the same time. In addition, it provides the sequence setting of IP and Alias.

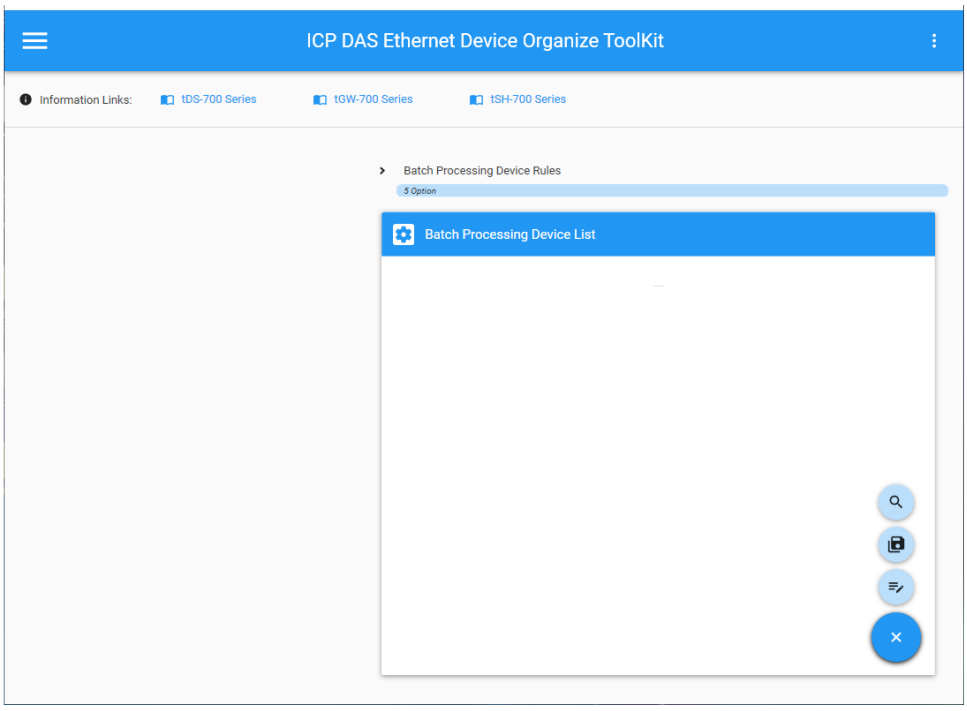

	**Search Ethernet Device**	Click this button to search for any devices server connected to the same sub network as the Host PC
	**Save ALL**	Batch the Network setting of all devices which in the Batch Processing Device List
	**Batch Edit Device Information**	Edit all devices in the Batch Processing Device List with Batch Processing Device Rules


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.1 How to batch several devices


Step 1

Click **Search Ethernet Device** to search devices and the devices will be shown at left Blank place.

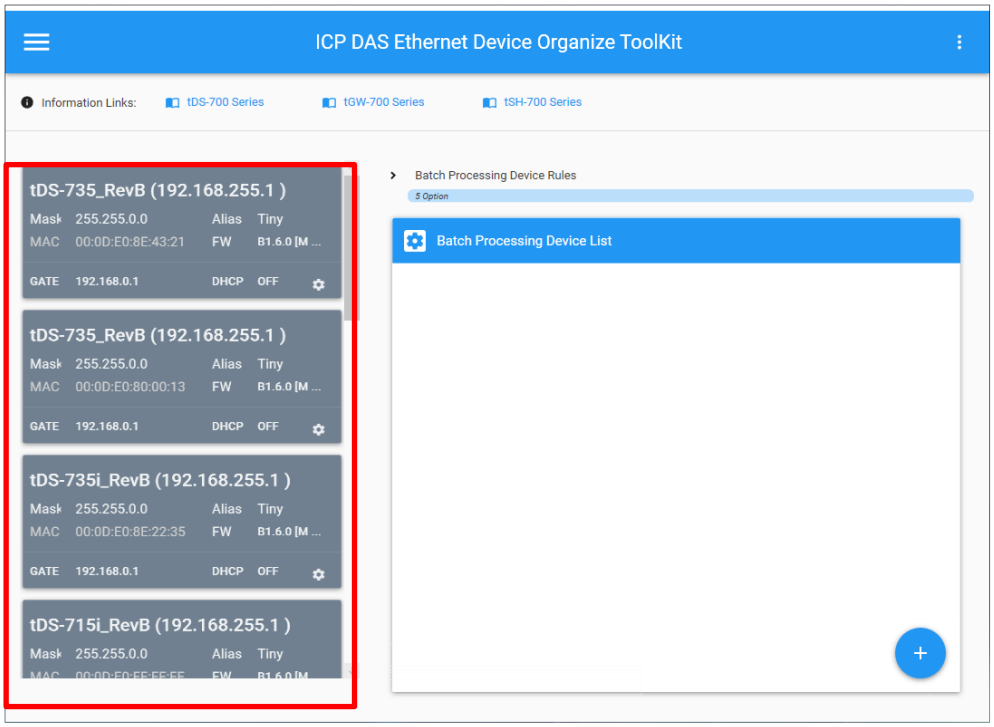

Step 2

Use the gear at the nook to set the Network setting of the first device.

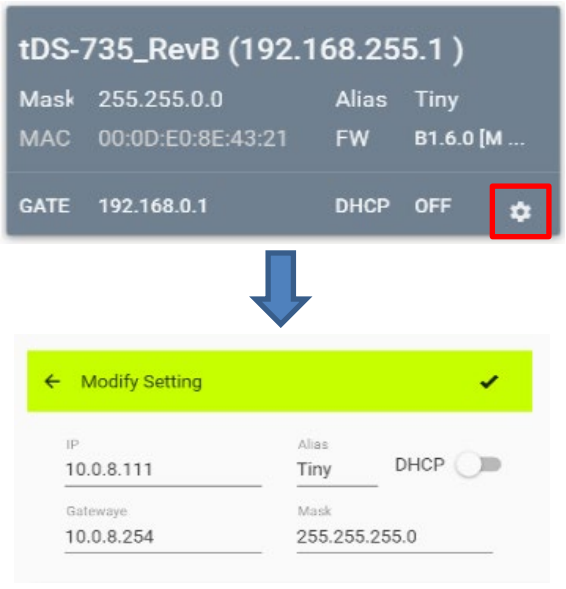


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


Step 3

Double click the devices which you want to process, and the devices will be added to the Batch Processing Device List.

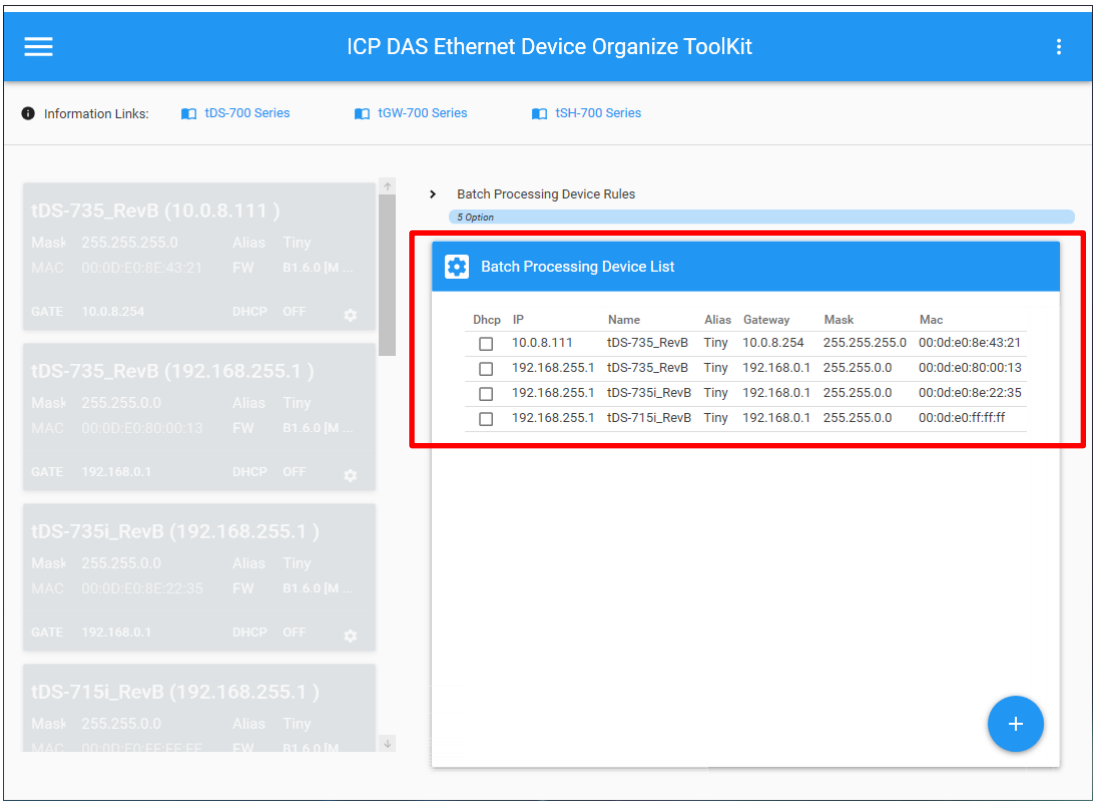

Step 4

Use the Batch Processing Device Rules to batch edit other devices.

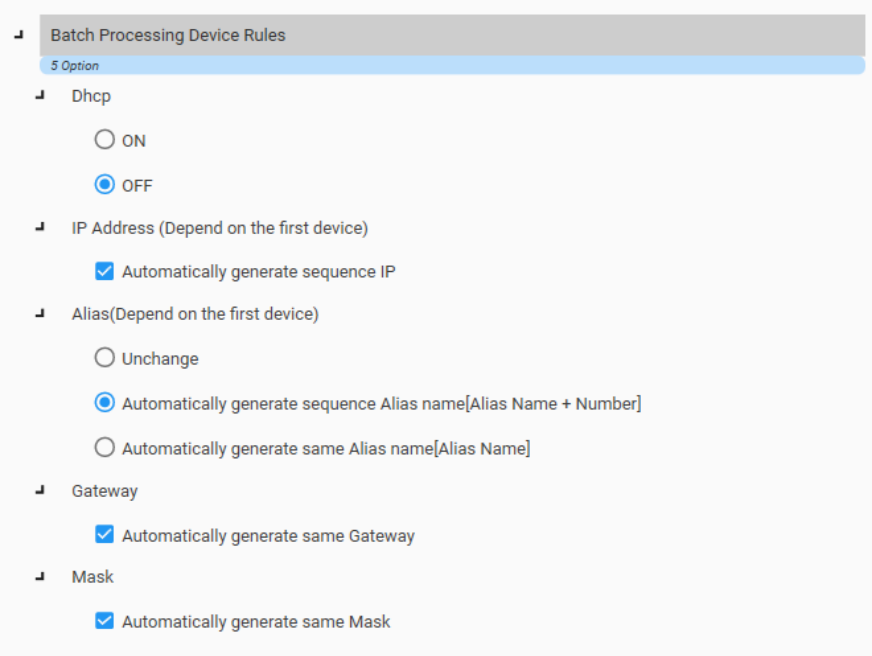


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


Step 5

Click **Batch Edit Device Information** to apply the Batch Processing Device Rules and you can preview the setting.

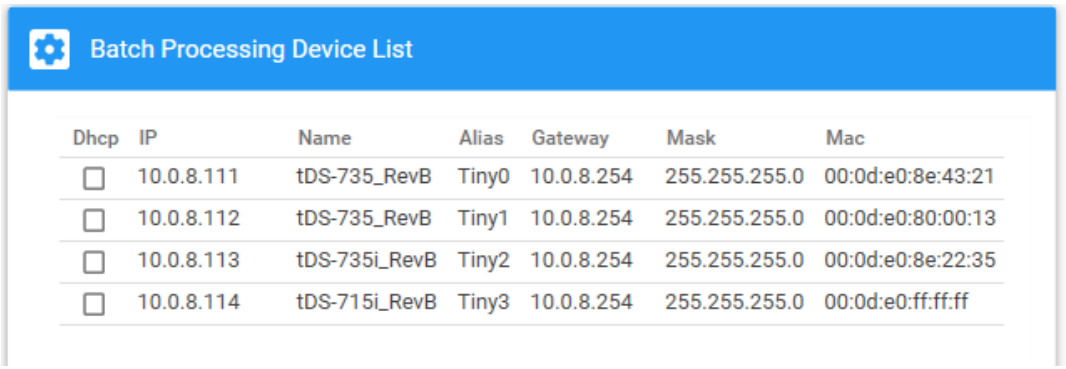

Step 6

Click **Save ALL** to apply the Network setting of all devices in the List. And you can view the performance at the left list.

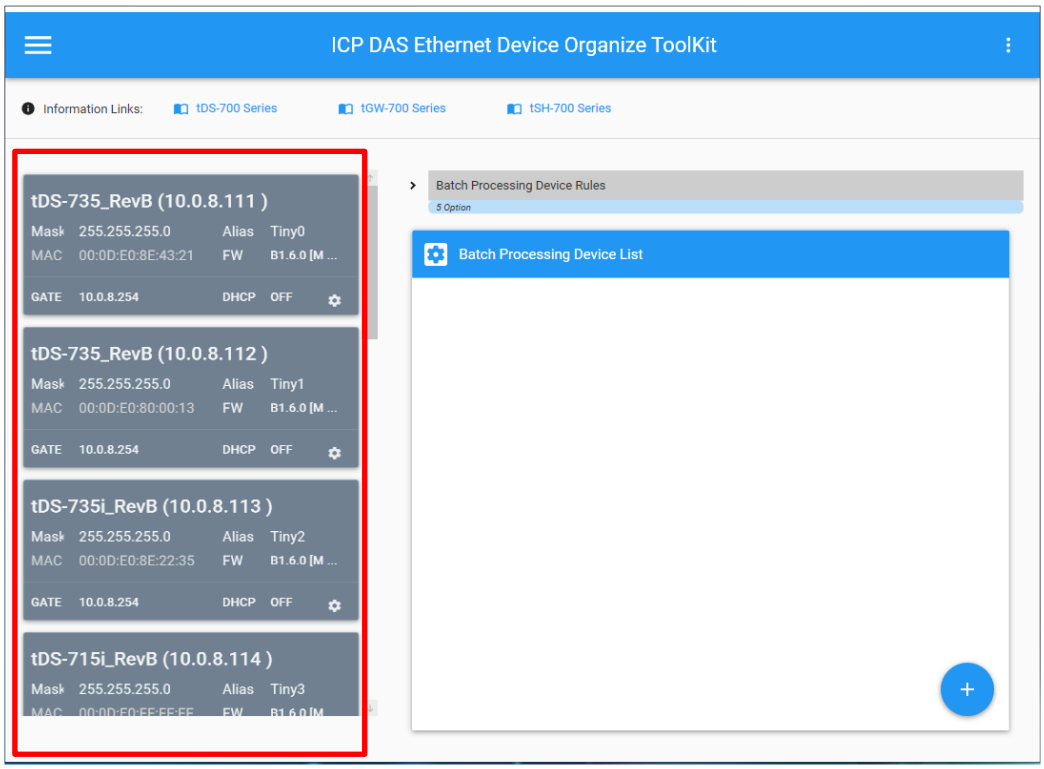


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3. Backup/Restore/Mass Configure

The main function in the EtherDOT is Mass Configure. In this page, the EtherDOT can mass configure several devices at the same time. And you can back up the setting which is often used.

Notice: The passwords of modules have to default “admin”

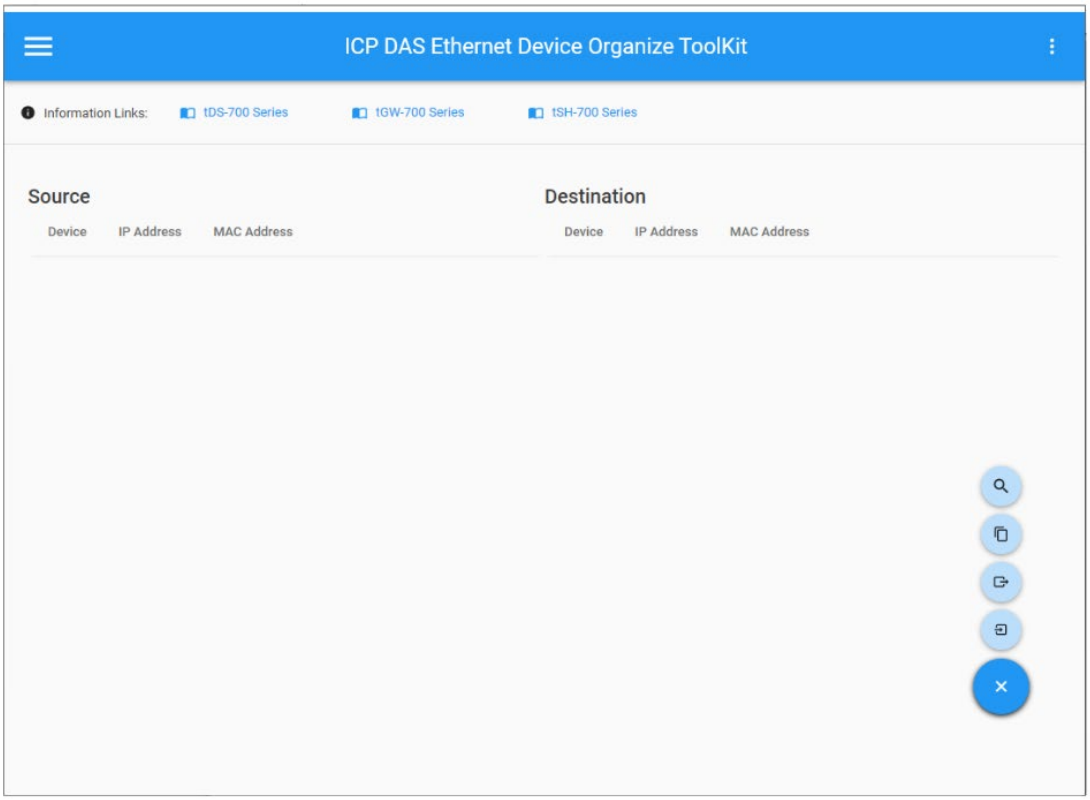

	**Scan Device**	Click this button to search for any devices server connected to the same sub network as the Host PC
	**Clone Setting**	After choosing the Source and Destination device, Click this button to clone the Web-Setting
	**Export Setting**	Export the Web-Setting of the selected Source device to backup
	**Import Setting**	Import the Web-Setting file as the Source device


Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.1 Backup

If the Web-Setting is often used, you can export it to backup. The method of backup is followed as :

Step 1

Click **Scan Device** to search devices and the devices will be shown at the Source list.

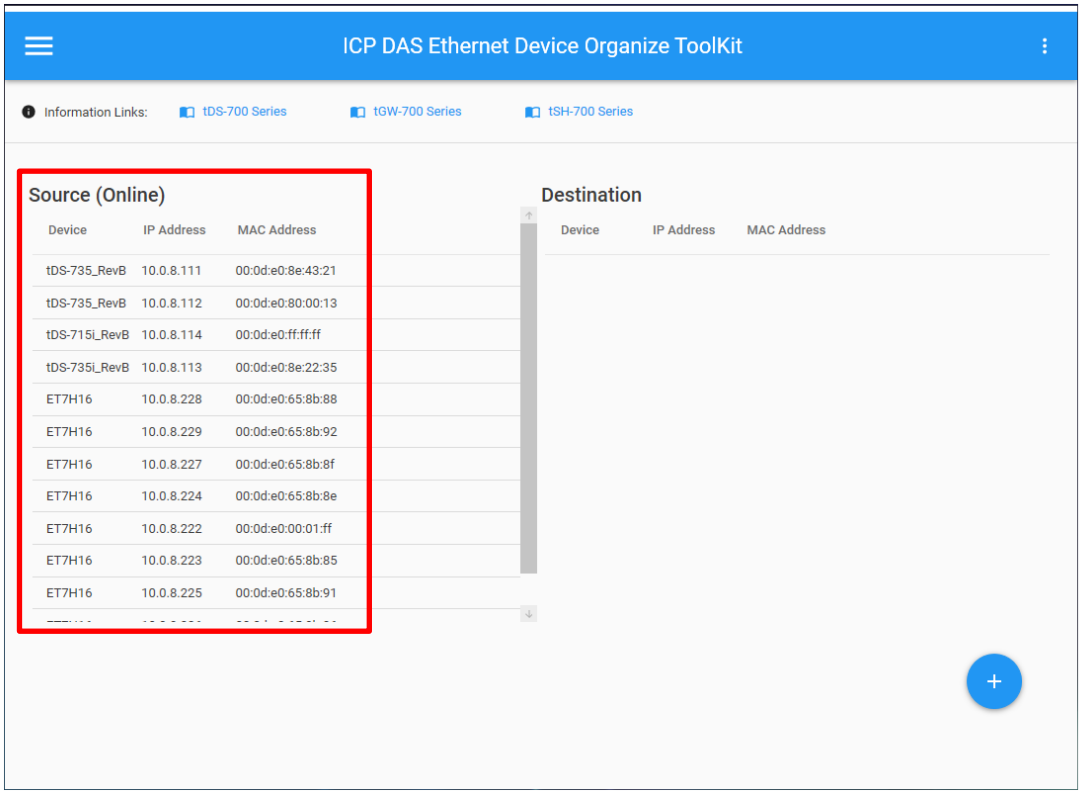


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


Step 2

Select the device which you want to backup and click the **Export Setting** button.

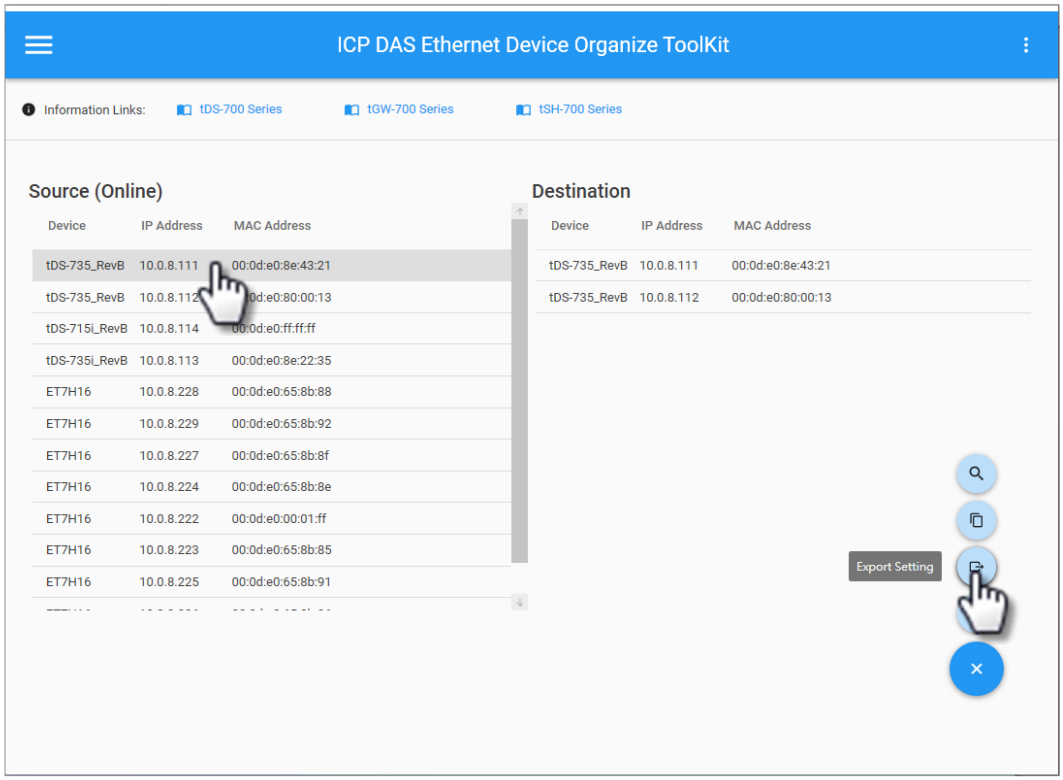

Step 3

Enter the file name and save.

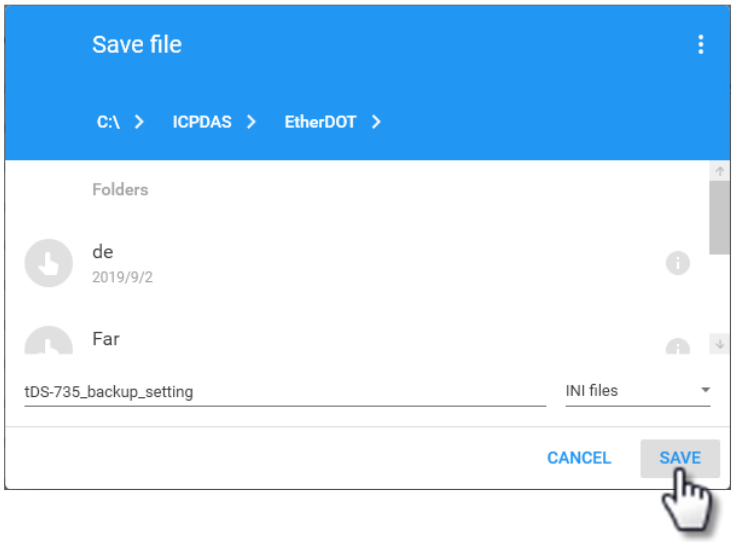



Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.2 Restore

Click the **Import Setting** button and Import the Web-Setting file as the Source device. After importing the file, the Destination list will show the same type devices.

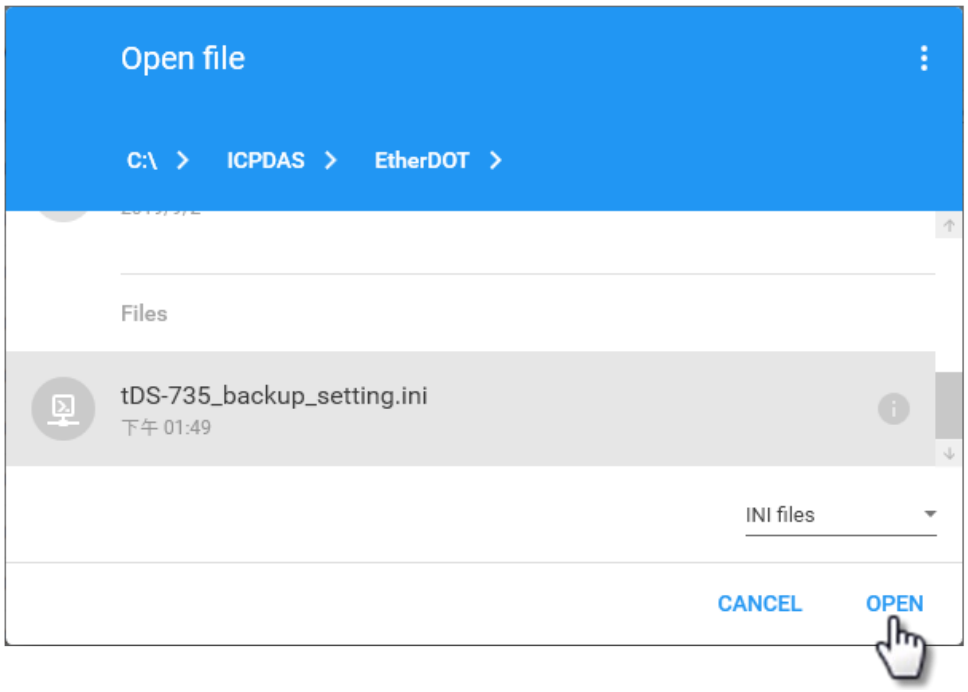

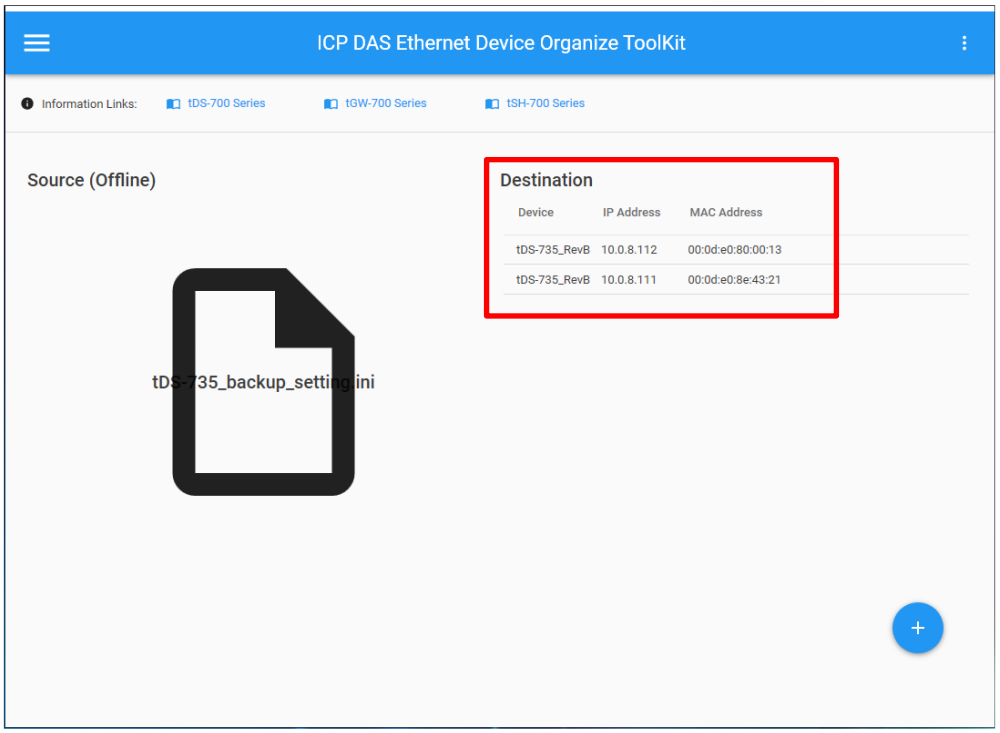

Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.3 Mass Configure


The main function in the EtherDOT. You can use it to batch several same type modules at the same time. It economizes much time to set Web-Settings.

Step 1

Design Web-Setting of your device which will be Source Device. Please refer the **Document Link** to design your Web-Setting.

Step 2

Click **Scan Device** to search devices and the devices will be shown at the Source list. (Or importing the file, please refer 3.2 Restore)

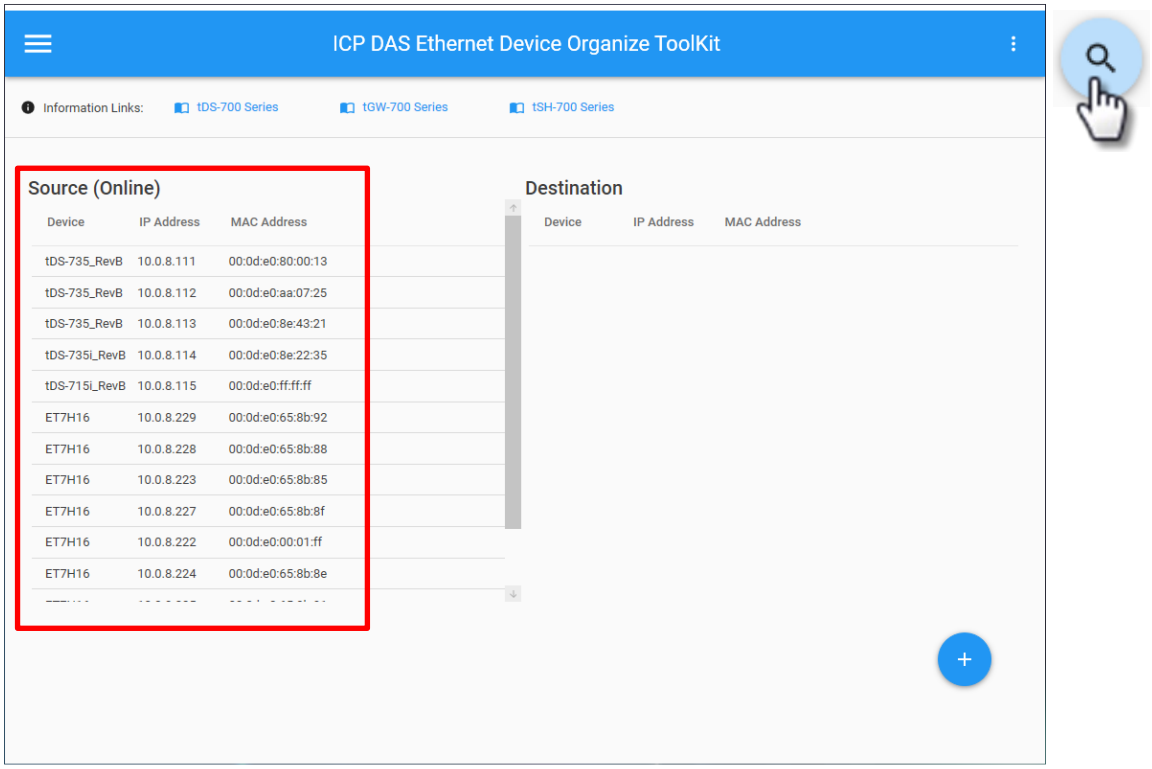


Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


Step 3

Select the Source Device which Web-Setting is designed and the Destination list will show the same type devices.

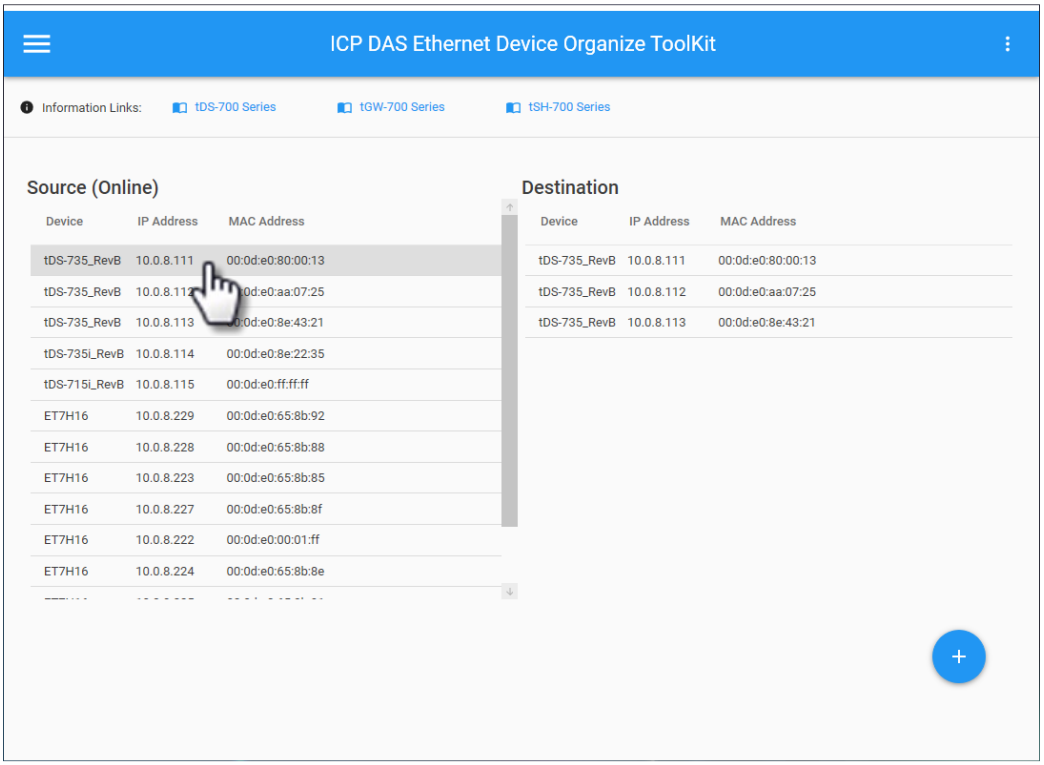

Step 4

Select the Destination Devices and click the **Clone Setting** button to batch them. (You can select several Destination Devices at once, like as schematic diagram)

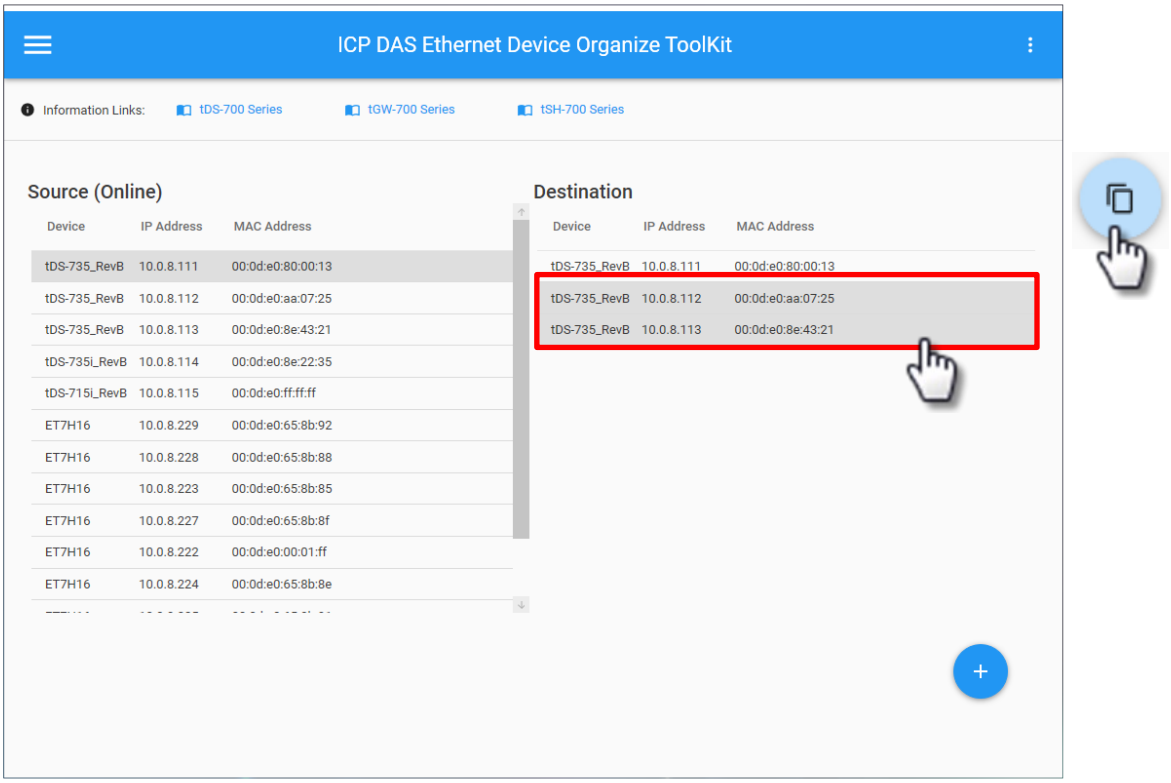

Copyright © 2019 ICP DAS Co., Ltd. All Rights Reserved. ✉E-mail:service@icpdas.com

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000