
I-7080, I-7080B

User Manual

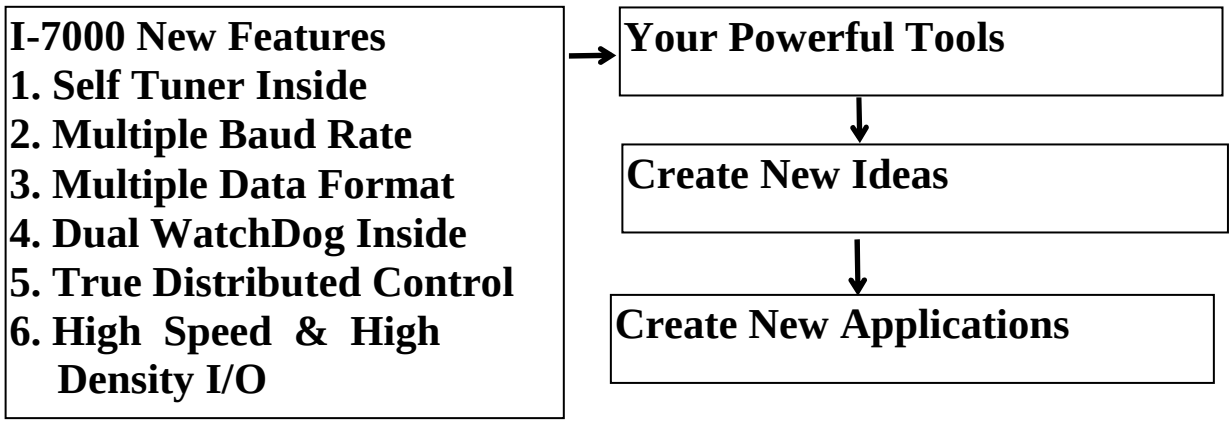

Warranty

All products manufactured by ICP DAS are warranted against defective materials for a period of one year from the date of delivery to the original purchaser.

Warning

ICP DAS assume no liability for damages consequent to the use of this product. ICP DAS reserves the right to change this manual at any time without notice. The information furnished by ICP DAS is believed to be accurate and reliable. However, no responsibility is assumed by ICP DAS for its use, nor for any infringements of patents or other rights of third parties resulting from its use.

Copyright

Copyright 1998 by ICP DAS. All rights are reserved.

Trademark

The names used for identification only maybe registered trademarks of their respective companies.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Table of Contents

1. INTRODUCTION....4

1.1 7080/7080D & 4080/4080D....5
1.2 PIN ASSIGNMENT....7
1.3 SPECIFICATIONS....8
1.4 BLOCK DIAGRAM....9
1.5 APPLICATION WIRING....10
1.6 QUICK START....12
1.7 DEFAULT SETTING....14
1.8 APPLICATION NOTES....14
1.9 TABLES....21

2. COMMAND SET....22

2.1 %AANNTTCCFF....25
2.2 #AAN....26
2.3 ~**....27
2.4 ~AA0....28
2.5 ~AA1....29
2.6 ~AA2....30
2.7 ~AA3ETT....31
2.8 ~AAAS....32
2.9 ~AAO(NAME)....33
2.10 $AA0H....34
2.11 $AA0H(DATA)....35
2.12 $AA0L....36
2.13 $AA0L(DATA)....37
2.14 $AA1H....38
2.15 $AA1H(DATA)....39
2.16 $AA1L....40
2.17 $AA1L(DATA)....41
2.18 $AA2....42
2.19 $AA3N....43
2.20 $AA3N(DATA)....44
2.21 $AA4....45
2.22 $AA4S....46
2.23 $AA5N....47
2.24 $AA5NS....48
2.25 $AA6N....49

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.26 $AA7N 50
2.27 $AA8 51
2.28 $AA8V 52
2.29 $AA9(DATA) 53
2.30 $AAA 54
2.31 $AAAG 55
2.32 $AAB 56
2.33 $AABS 57
2.34 $AAF 58
2.35 $AAI 59
2.36 $AAM 60
2.37 @AADI 61
2.38 @AADO0D 62
2.39 @AAEAN 63
2.40 @AAEAT 64
2.41 @AACA 65
2.42 @AADA 66
2.43 @AADAN 67
2.44 @AAGN 68
2.45 @AAPN(DATA) 69
2.46 @AAPA(DATA) 70
2.47 @AAPA(DATA) 71
2.48 @AASA(DATA) 72
2.49 @AASA(DATA) 73
2.50 @AARP 74
2.51 @AARP 75
2.52 @AARA 76
2.53 @AARP 77

3. OPERATIONS PRINCIPLE & APPLICATION NOTES 78

3.1 INIT*_PIN OPERATION PRINCIPLE 78
3.2 D/O OPERATION PRINCIPLE 79
3.3 New Features of 7080B 80

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1. Introduction

I-7000 is a family of network data acquisition and control modules. They provide A/D, D/A, DI/O, Timer/Counter and other functions. These modules can be remote controlled by a set of commands. The common features of I-7080 and I-7080D are given as following:

2 independent 32-bit counter, counter 0 & counter 1
input signal can be isolated or non-isolated
programmable digital filter for isolated and non-isolated input
external gate control for isolated and non-isolated input
programmable threshold value for non-isolated input.
programmable alarm output
input frequency measurement up to 100K Hz

The I-7080D is the I-7080 with a 5-digit LED display. The counter value and input signal frequency can be shown in LED directly without PC control. The I-7080B will save the counter value to EEPROM when the power goes off. Refer to Sec. 3.3 for details.

More Information

Refer to "I-7000 Bus Converter User Manual" chapter 1 for more information as following:

1.1 I-7000 Overview
1.2 I-7000 RELATED DOCUMENTATION
1.3 I-7000 COMMON FEATURES
1.4 I-7000 SYSTEM NETWORK CONFIGURATION
1.5 I-7000 Dimension

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.1 7080/7080D & 4080/4080D

Comparison between I-7080 & I-7080D

	I-7080	I-7080D
5-digit LED	No	Yes
Response to LED command	No	Yes
Module name	programmable	programmable
Counter preset value	Yes(programmable)	Yes(programmable)
Alarm on counter 0 only	Yes(programmable)	Yes(programmable)
Alarm on counter 0&1	Yes(programmable)	Yes(programmable)
Channel 0 & channel 1 are both non-isolated (input mode 0, $AAB0)	Yes	Yes
Channel 0 & channel 1 are both isolated (input mode 1, $AAB1)	Yes	Yes
Channel 0 is non-isolated & channel 1 is isolated (input mode 2, $AAB2)	Yes	Yes
Channel 0 is isolated & channel 1 is non-isolated (input mode 3, $AAB3)	Yes	Yes
Input frequency	100K max.	100K max.
Default setting	4080 compatible	4080D compatible

default setting of I-7080:

- High alarm on counter 0 & 1
- Counter preset value: 0
- Module name: 7080

default setting of I-7080D:

- High/High-High alarm on counter 0
- Counter preset value: 0
- Module name: 7080D

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


Comparison between 4080 & 4080D

	4080	4080D
5-digit LED	No	Yes
Response to LED command	No	Yes
Module name	4080	4080D
Counter preset value	Yes	No
Alarm on counter 0 only	No	Yes
Alarm on counter 0&1	Yes	No
Channel 0 & channel 1 are both non-isolated (input mode 0, $AAB0)	Yes	Yes
Channel 0 & channel 1 are both isolated (input mode 1, $AAB1)	Yes	Yes
Channel 0 is non-isolated & channel 0 is isolated (input mode 2, $AAB2)	No	No
Channel 0 is isolated & channel 1 is non-isolated (input mode 3, $AAB3)	No	No
Input frequency	50K max.	50K max.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.2 Pin Assignment

Isolated Input

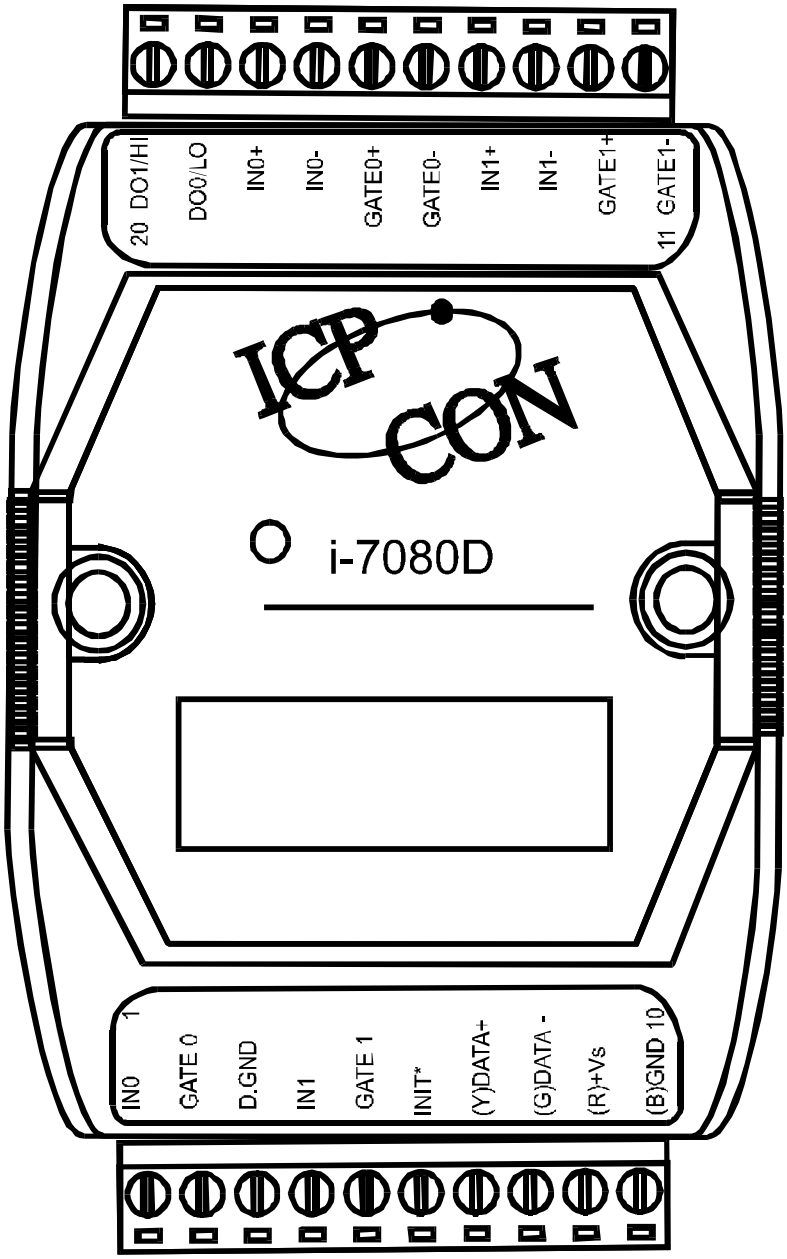

Non-isolated Input

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.3 Specifications

i-7080: Counter/Frequency Module
i-7080D: i-7080 with LED Display
i-7080B: Refer to Sec. 3.3 for details.
i-7080BD: Refer to Sec. 3.3 for details.

Counter Input

- Channels: Two independents 32 bit counters, counter 0&1
- Input signal: Isolated or non-isolated programmable
- Isolation input levels:
  Logic level 0: +1V max.
  Logic level 1: +3.5V to +30V
- Isolation voltage: 3750 Vrms
- non-isolation input threshold level: programmable
  Logic level 0: 0 to +5V (default = 0.8V)
  Logic level 1: 0 to +5V (default = 2.4V)
- Maximum count: 32 bit (4,294,967,295)
- Programmable digital noise filter: 2 us to 65 ms
- Alarming: alarm on counter 0 or counter 0&1, programmable
- Counter preset value: programmable

Display

- LED Indicator: 5-digit readout, channel 0 or channel 1

Frequency Measurement

- Input frequency: 1Hz to 100K Hz max.
- Programmable built-in gate time: 1.0/0.1sec

Digital Output


- 2 channels, open-collector to 30V, 30mA max. load
- Power dissipation: 300mW

Power

- Power requirements:
  I-7080/7080D: +10V to 30V(non-regulated)
  I-7080B/7080BD: +24V to 30V(non-regulated)
- Power consumption : 2W for I-7080, 2.2W for I-7080D

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.4 Block Diagram

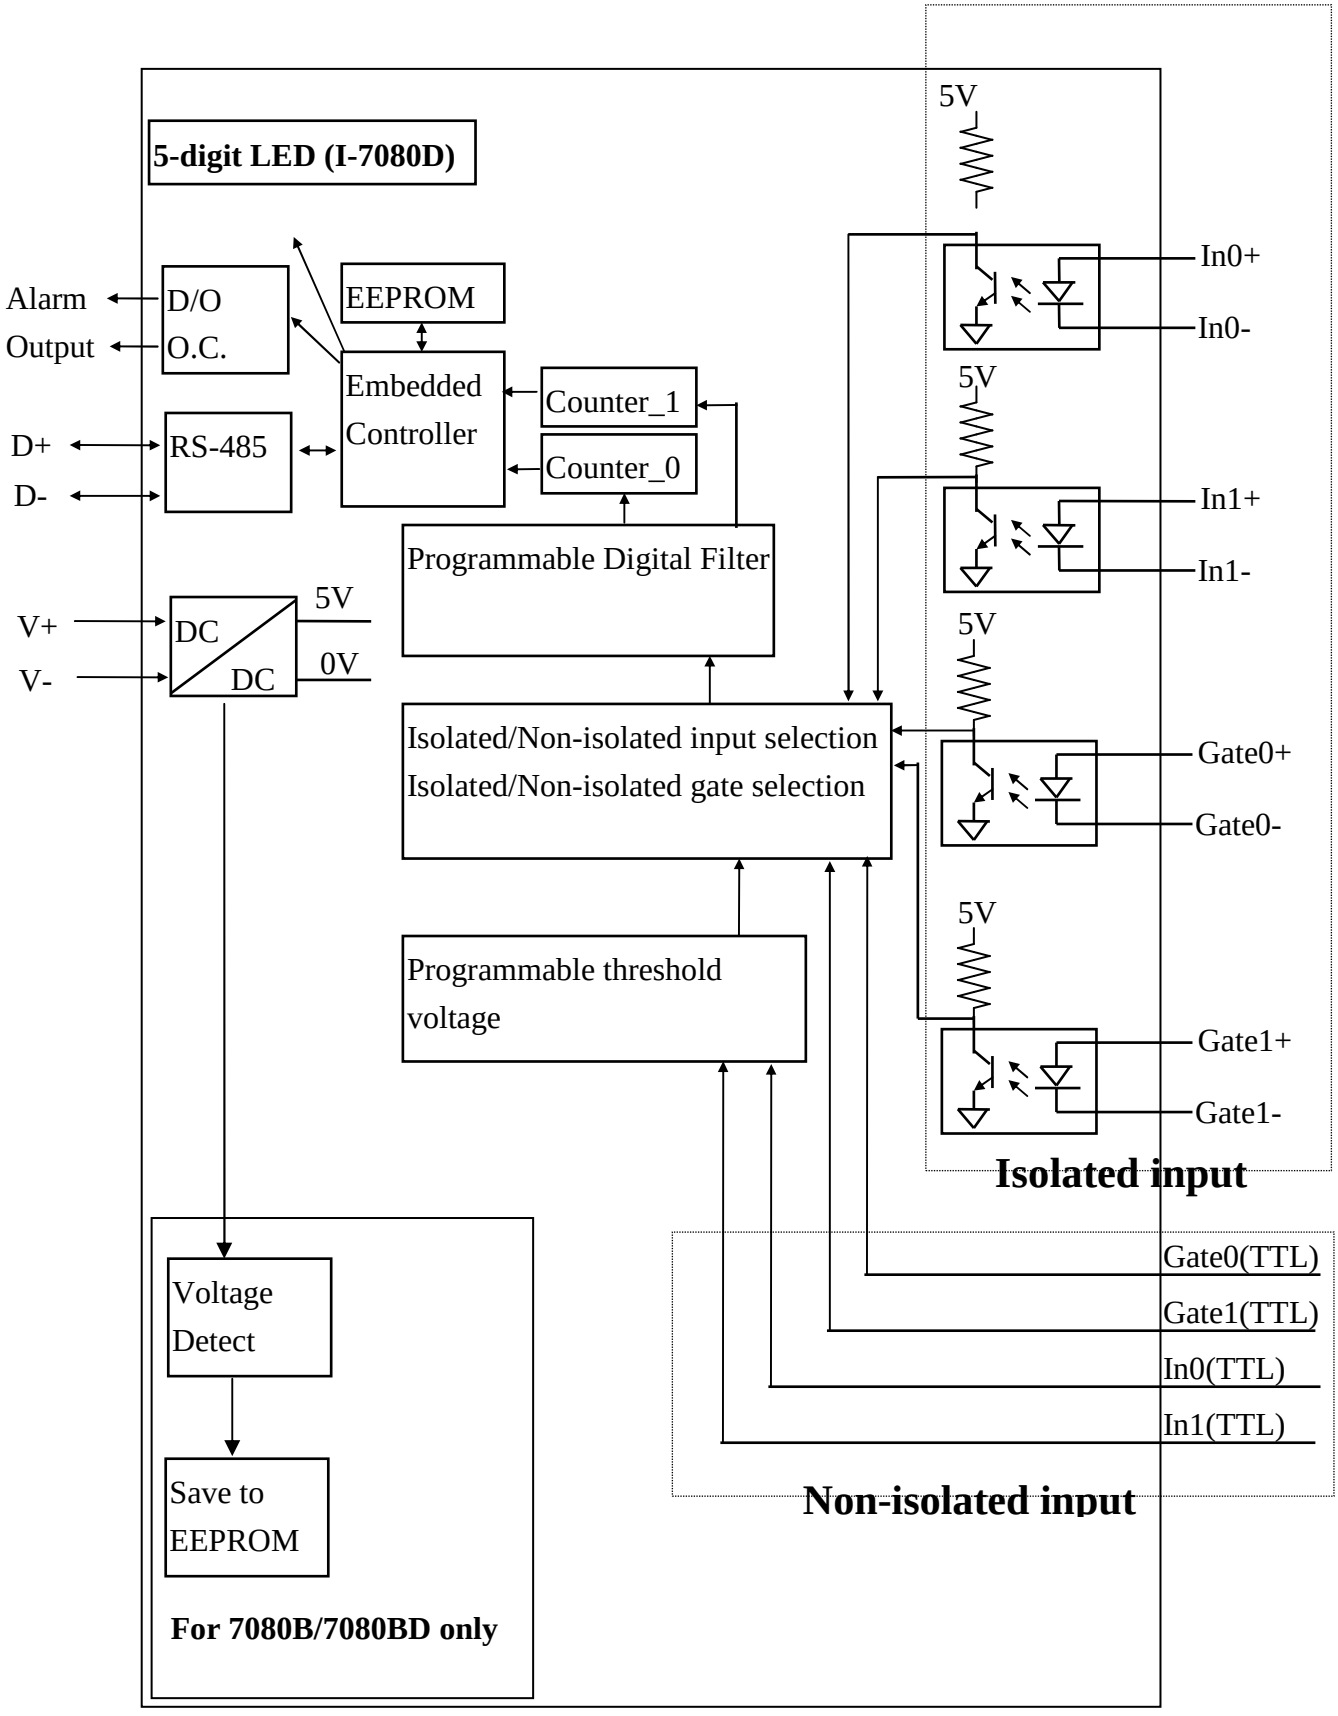


LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.5 Application Wiring

1.5.1 Output Drive SSR or Other Load

I-7018 & I-7018D

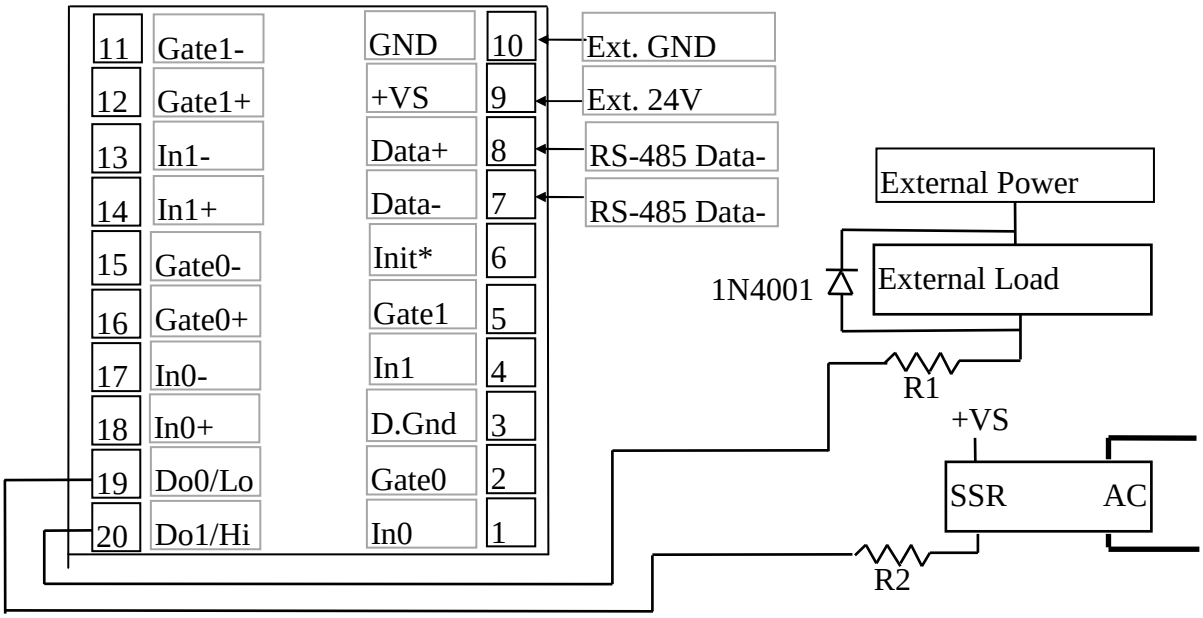


Note:

- If the external load is resistive load, the 1N4001 can be omitted. (transistor, lamp, resistor, …)
- If the external load is inductive load, the 1N4001 can’ t be omitted. (relay, coil, …)

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000


1.5.2 Frequency Input

Use $AABS command to select isolated/non-isolated input.

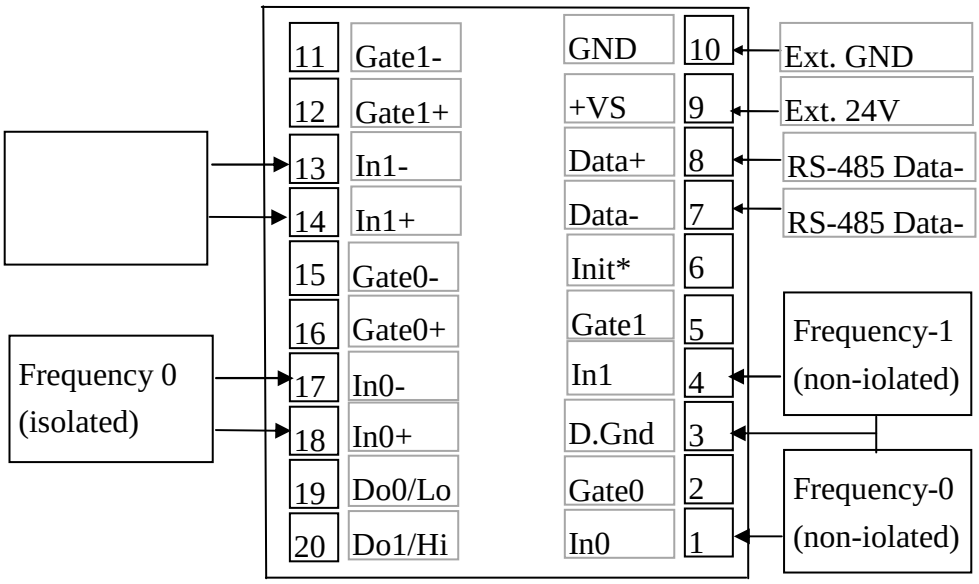

I-7018 & I-7018D

1.5.3 Counter Input

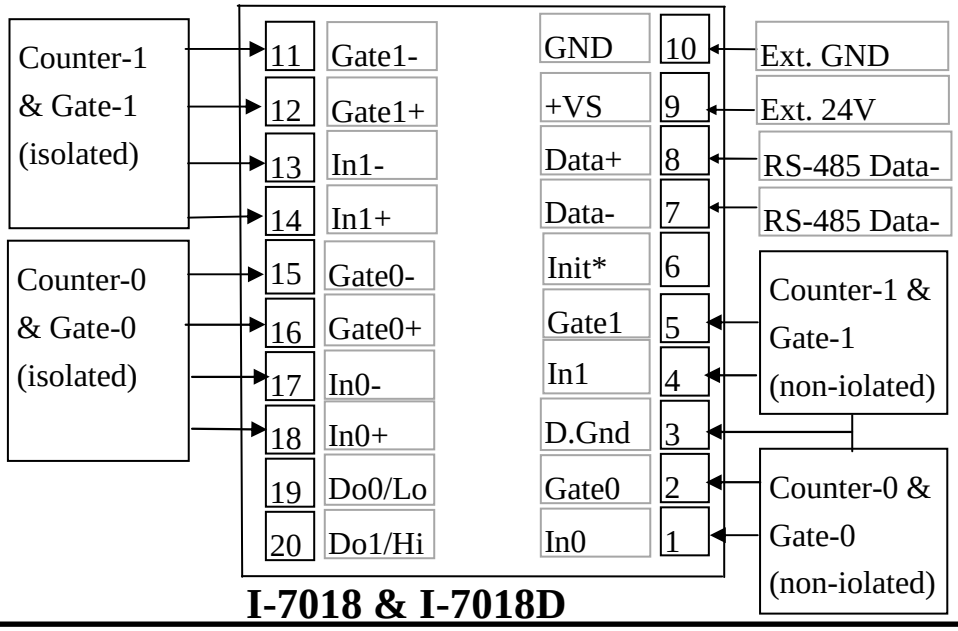

I-7018 & I-7018D

Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.6 Quick Start

Refer to "I-7000 Bus Converter User Manual" chapter-5 for the following functions:

- **module status unknown**(Sec. 5.1), **change address**(Sec. 5.2)
- **change baud rate**(Sec. 5.3), **checksum enable/disable**(Sec. 5.4)
- Wire connection(Sec 2.4)
- Test program **TEST.EXE**(Refer to "NAP7000S User Manual" for details.

1.6.1 Frequency Input Measurememt

1. Refer to Sec. 1.5.2 for wire connection. Power on and run **test.exe**
2. press **2**
3. press **$012[Enter]** → Receive=!01500600
4. press **2**
5. press **%0101510600[Enter]**→ Receive=>!01
6. press **2**
7. press **$01B0[Enter]** → Receive=!01
8. press **2**
9. press **#010[Enter]** → Receive=>????????
10. press **2**
11. press **#011[Enter]** → Receive=>????????

- step 3: the status of I-7080 is COUNTER mode
- step 5: change to frequency mode
- step 7: select non-isolated input
- step 9: frequency measurement of channel-0
- step 11: frequency measurement of channel-1

Note: the command **$01B1**(step 7) can be used to select the isolated input.**(**the command **$01B2** and **$01B3** are used for the other selections)

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.6.2 Counter input Measurement

1. Refer to Sec. 1.5.2 for wire connection. Power on and run **test.exe**
2. press **2**
3. press **$012[Enter]** → Receive=!01500600
4. press **2**
5. press **$01B0[Enter]** → Receive=!01
6. press **2**
7. press **#010[Enter]** → Receive=>????????
8. press **2**
9. press **#011[Enter]** → Receive=>????????

- step 3: the status of I-7080 is COUNTER mode
- step 5: select non-isolated input
- step 7: counter measurement of channel-0
- step 9: counter measurement of channel-1

Note: the command **$01B1**(step 7) can be used to select the isolated input.**(**the command **$01B2** and **$01B3** are used for the other selections)

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.7 Default Setting

The default setting is given as following:

- address=01
- baud rate=9600
- checksum disable
- data=1 start+8 data+1 stop(no parity)
- type=50 → counter input
- alarm=hi alarm on counter 0 & counter 1 (I-7080)
  hi/hi-hi alarm on counter 0 (I-7080D)

1.8 Application Notes

1.8.1 Counter/Frequency Input Mode Selection

The counter/frequency input can be selected from isolated or non-isolated signal. The channel 0 & channel 1 can be selected separately. There are 4 different input mode given as following: These four input modes can be used in both of I-7080 & I-7080D.

Input Mode	Command	Channel 0	Channel 1
Input mode 0	$AAB0	Non-isolated	Non-isolated
Input mode 1	$AAB1	Isolated	Isolated
Input mode 2	$AAB2	Non-isolated	Isolated
Input mode 3	$AAB3	Isolated	Non-isolated

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.2 Counter Alarm Mode Selection

There are no alarm function in frequency mode(51). There are two counter alarm mode, alarm mode 0 & alarm mode 1. These two alarm modes can be used in both of I-7080 & I-7080D.

The **alarm mode 0** is designed for two-channel application as following:

select alarm mode 0: ~AAA0 (for both channels)

enable channel 0: @AAEA0
disable channel 0: @AADA0
set high alarm limit of channel 0: @AAPA(data)
if (counter 0 >= alarm limit 0) → D/O 0 turn ON
if (counter 0 < alarm limit 0) → D/O 0 turn OFF

enable channel 1: @AAEA1
disable channel 1: @AADA1
set high alarm limit of channel 1: @AASA(data)
if (counter 1 >= alarm limit 1) → D/O 1 turn ON
if (counter 1 < alarm limit 1) → D/O 1 turn OFF

The **alarm mode 1** is designed for single-channel application as following:

select alarm mode 1: ~AAA1 (for channel 0 only)
enable channel 0: @AAEAT
disable channel 0: @AADA
clear latch alarm: @AACA
set high alarm limit: @AAPA(data)
set high-high alarm limit: @AASA(data)

	D/O 0	D/O 1
Counter 0 < high alarm	OFF	OFF
high alarm <= counter 0 & counter 0 < high-high alarm	ON	OFF
High-high alarm <= counter 0	ON	ON

Note: high-high alarm must greater than high-alarm

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.3 Digital Output Application Notes

The D/O0 & D/O1 can be used as D/O or alarm output as following:

- can be used as D/O in the frequency mode.
- can be used as D/O in the counter mode & alarm disable (by @AADA or @AADAN command)
- can be used as alarm output in the counter mode & alarm enable(by @AAEAT or @AAEAN command)

	D/O 0	D/O 1
Frequency mode	D/O 0	D/O 1
Counter mode & alarm disable	D/O 0	D/O 1
Counter mode & alarm enable (alarm mode 1, ~AAA1)	High-alarm on counter 0	High-high alarm on counter 0
Counter mode & alarm enable (alarm mode 0, ~AAA0 & @AAEA0)	Alarm on counter 0	D/O 1 or alarm on counter 1
Counter mode & alarm enable (alrm mode 0, ~AAA0 & @AAEA1)	D/O 0 or alarm on counter 0	alarm on counter 1

1.8.4 Programmable Threshold Voltage Setting

The programmable threshold voltage is valid for non-isolated input of **counter mode (50) & frequency mode(51)**. The default setting are given as following:

TTL compatible

low trigger level = 0.8 volt

high trigger level = 2.4 volt

The high trigger level can be changed by $AA1H(data) command, the low trigger can be changed by $AA1L(data) comand. The high trigger level must be greater than the low trigger level.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.5 Digital Filter Setting

The digital filter is disable in frequency mode(51). The digital filter is designed as a pulse-width filter in both high/low pulse. The digital filter is valid for both nono-isolated & isolated input. The digital filter can be enable or disable. The key points of using digital filter are given as following:

1. Use $AABS to select input signal.
2. Use $AA0H(data) to set min. width of high level.
3. Use $AA0L(data) to set min. width of low level.
4. Use $AA4S to enable/disbale digital filter (both channels).

If the high width of input signal is small than the min. high width of digital filter, this input signal will be filtered out. Also the low width of input signal must be greater than the min. low width of digital filter.

For example, the width of input signal is greater than 1000 us, the user can set the digital filter at 900 us. Therefore all noise below 900 us will be filtered out by the digital filter. These steps are given as following:

1. $AAB0
2. $AA0H00900
3. $AA0L00900
4. $AA41

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.6 Gate Control Setting

The gate control will be ignored in frequency mode(51).
The gate control is defaultly disable in counter mode(50). The user can use command to enable/disable the gate control as following:

$AAA0 → gate input must be low to enable counter
$AAA1 → gate input must be high to enable counter
$AAA2 → gate input is ignored. The counter will be always enable.

1.8.7 Preset Value Setting

The preset value will be ignored in frequency mode(51).
The counters will go to their preset value in the first power-on state. The reset counter command, $AA6N, also force the counters go to their preset value. The factory default setting of preset value is 0. The user can use the $AAPN(data) command to change the preset value. The key points are given as following:

	I-7080 & I-7080D
Factory default setting	Counter preset value is 0
Power on state	Counter 0/1 go to preset value
$AA6N	Counter N go to preset value
$AAPN(data)	Set preset value of counter N

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.8 Frequency Input Applications

Type=51

	Frequency 0	Frequency 1
$AAB0 → input mode 0 $AA1H(data) & $AA1L(data)	Non-isolated channel 0 & threshold value active	Non-isolated channel 1 & threshold value active
$AAB1 → input mode 1 $AA1H(data) & $AA1L(data)	Isolated channel 0	Isolated channel 1
$AAB2 → input mode 2 $AA1H(data) & $AA1L(data)	Non-isolated channel 0 & threshold value active	Isolated channel 1
$AAB3 → input mode 3 $AA1H(data) & $AA1L(data)	Isolated channel 0	Non-isolated channel 1 & threshold value active

The steps to measure frequency are given as following:

1. Use $AA1H(data) & $AA1L(data) to set the threshld value if the frequency is non-isolated input.
2. Use $AAB? to select the mode (this command will clear the current frequency first)
3. Use #AA? to perform frequency measurement

Note: Only four commands are important in frequency measurement mode. These commands are given as following:

- **$AAB? → select mode**
- **$AA1H(data) → set high-level threshold value**
- **$AA1L(data) → set low_level threshold value**
- **#AA? → perform frequency measurement**

The status-read-back commands are given as following:

- **$AAB → mode read back**
- **$AA1H → high_level threshold value read back**
- **$AA1L(data) → low_level threshold value read back**

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.8.9 Counter Input Applications

Tyepe=50

	Counter 0	Counter 1
$AAB0 → input mode 0 $AA1H(data) & $AA1L(data)	Non-isolated channel 0 & threshold value active	Non-isolated channel 1 & threshold value active
$AAB1 → input mode 1 $AA1H(data) & $AA1L(data)	Isolated channel 0	Isolated channel 1
$AAB2 → input mode 2 $AA1H(data) & $AA1L(data)	Non-isolated channel 0 & threshold value active	Isolated channel 1
$AAB3 → input mode 3 $AA1H(data) & $AA1L(data)	Isolated channel 0	Non-isolated channel 1 & threshold value active

Note: the threshold value command, $AA1H(data) & $AA1L(data) are effective to Non-isolated input only.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

1.9 Tables

Configuration Code Table : CC

CC	Baud Rate
03	1200 BPS
04	2400 BPS
05	4800 BPS
06	9600 BPS
07	19200 BPS
08	38400 BPS
09	57600 BPS
0A	115200 BPS

Configuration Code : FF, 2-char (for all)

7	**6**	**5**	**4**	**3**	**2**	**1**	**0**
0	checksum 0=disable 1=enable	0			frequency gate time 0: 0.1 second 1: 1.0 second	0	

Configuration Code Table: TT

TT	Input Range
50	Counter
51	Frequency

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2. Command Set

General Command Set

Command	Response	Description	Reference
%AANNTTCCFF	!AA	Set module configuration	Sec. 2.1
#AAN	>(data)	Read counter or frequency	Sec. 2.2
~**	No Response	Host OK	Sec. 2.3
~AA0	!AASS	Read Module Status	Sec. 2.4
~AA1	!AA	Reset Module Status	Sec. 2.5
~AA2	!AATT	Read Host Watchdog Timer	Sec. 2.6
~AA3ETT	!AA	Enable Host Watchdog Timer	Sec. 2.7
~AAO(name)	!AA	Set module name	Sec. 2.9
$AA2	!AATTCCFF	Read configuration	Sec. 2.18
$AAF	!AA(data)	Read firmware number	Sec. 2.34
$AAI	!AAS	Read the value of INIT* pin	Sec. 2.35
$AAM	!AA(data)	Read the module name	Sec. 2.36

Frequency Command Set

Command	Response	Description	Reference
$AAB	!AAS	Read input mode	Sec. 2.32
$AABS	!AA	Set input mode	Sec. 2.33
$AA1H	!AA(data)	Read high trigger level	Sec. 2.14
$AA1H(data)	!AA	Set high trigger level	Sec. 2.15
$AA1L	!AA(data)	Read low trigger level	Sec. 2.16
$AA1L(data)	!AA	Set low trigger level	Sec. 2.17

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

General Counter Command Set

~AAAS	!AA	Set counter alarm mode	Sec. 2.8
$AA0H	!AA(data)	Read min. width of High	Sec. 2.10
$AA0H(data)	!AA	Set min. width of High	Sec. 2.11
$AA0L	!AA(data)	Read min. width of High	Sec. 2.12
$AA0L(data)	!AA	Set min. width of High	Sec. 2.13
$AA1H	!AA(data)	Read high trigger level	Sec. 2.14
$AA1H(data)	!AA	Set high trigger level	Sec. 2.15
$AA1L	!AA(data)	Read low trigger level	Sec. 2.16
$AA1L(data)	!AA	Set low trigger level	Sec. 2.17
$AA3N	!AA(data)	Read max. counter value	Sec. 2.19
$AA3N(data)	!AA	Set max. counter value	Sec. 2.20
$AA4	!AAS	Read filter status	Sec. 2.21
$AA4S	!AA	Set filter status	Sec. 2.22
$AA5N	!AAS	Read the counter status	Sec. 2.23
$AA5NS	!AA	Set the counter status	Sec. 2.24
$AA6N	!AA	Reset counter	Sec. 2.25
$AA7N	!AAS	Read overflow status	Sec. 2.26
$AAA	!AAG	Read gate mode	Sec. 2.30
$AAAG	!AA	Set gate mode	Sec. 2.31
$AAB	!AAS	Read input mode	Sec. 2.32
$AABS	!AA	Set input mode	Sec. 2.33
@AADI	!AAS0D00	Read D/O & alarm state	Sec. 2.37
@AADO0D	!AA	Set D/O value	Sec. 2.38
@AAGN	!AA(data)	Read preset value	Sec. 2.44
@AAPN(data)	!AA	Set preset value	Sec. 2.45

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

Alarm-mode 0 Command Set

@AAEAN	!AA	Enable alarm	Sec. 2.39
@AADAN	!AA	Disabel alarm	Sec. 2.43
@AAPA(data)	!AA	Set counter 0 alarm value	Sec. 2.46
@AASA(data)	!AA	Set counter 1 alarm value	Sec. 2.48
@AARP	!AA	Read counter 0 alarm value	Sec. 2.50
@AARA	!AA	Read counter 0 alarm value	Sec. 2.52

Alarm-mode 1 Command Set

@AAEAT	!AA	Enable alarm	Sec. 2.40
@AACA	!AA	Clear larch alarm	Sec. 2.41
@AADA	!AA	Disabel alarm	Sec. 2.42
@AAPA(data)	!AA	Set Hi-alarm value	Sec. 2.47
@AASA(data)	!AA	Set Hi-Hi-alarm value	Sec. 2.49
@AARP	!AA	Read Hi-alarm value	Sec. 2.51
@AARA	!AA	Read Hi-Hi-alarm value	Sec. 2.53

LED Command Set

$AA8	!AAS	Read LED configuration	Sec. 2.27
$AA8V	!AA	Set LED configuration	Sec. 2.28
$AA9(data)	!AA	Send data to LED	Sec. 2.29

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.1 %AANNTTCCFF

7080/7080D

- **Description**: Set the configuration of module.

- **Syntax**: %AANNTTCCFF[chk](cr)
  % is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  NN=new AA
  TT=input type code, refer to Sec. 1.9
  CC=baud rate code, refer to Sec. 1.9
  FF=status code, refer to Sec. 1.9
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:
  command: %0102500600(cr)
  response : !02(cr)

  address 01 is configured to a new address 02, counter

  command: %0202510600(cr)
  response : !02(cr)

  Change to frequency mode.

Refer to "I-7000 Bus Converter User Manual" chapter-5 for the following functions:

- **module status unknown**(Sec. 5.1), **change address**(Sec. 5.2)
- **change baud rate**(Sec. 5.3), **checksum enable/disable**(Sec. 5.4)

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.2 #AAN

7080/7080D

- **Description**: Read counter or frequency value.

- **Syntax**: #AAN[chk](cr)
  # is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → channel-0 of counter or frequency
  1 → channel-1 of counter or frequency
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → >[chk](data)(cr)
  invalid command → No Response
  no response → syntax error or communication error or address error
  > is a delimiter character indicating a valid command
  (data) = 8-character data(in HEX format)
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $012(cr)
response : !01500600(cr)
command: #010(cr)
response : >0000001E(cr)

Counter-0=0x1E=30 (in decimal)

command: $022(cr)
response : !02510600(cr)
command: #021(cr)
response : >0000001E(cr)

Frequency-1=0x1E Hz = 30 Hz (in decimal)

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.3 ~**

7080/7080D

- **Description**: Host send this command to tell all modules "Host is OK".

- **Syntax**: ~**[chk](cr)
  ~ is a delimiter character
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: no response

- **Example**:
  command: ~**(cr)
  response : No Response

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.4 ~AA0

7080/7080D

- **Description**: Read the module status. The module status will be latched until ~AA1 command is sent**. If the host watchdog is enable and the host is down, the module status will be set to 4. If the module status=4, all output command will be ignored.**

- **Syntax**: ~AA0[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AASS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  SS=2-character HEX status value as following:
  Bit_0, Bit_1 = reserved
  Bit_2 = 0 → OK,
  1 → host watchdog failure
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: ~010(cr)
response : !0100(cr)

Status of module 01 is OK

command: ~020(cr)
response : !0204(cr)

Module status=04 → host watchdog failure → HOST is down now

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.5 ~AA1

7080/7080D

- **Description**: Reset the module status. The module status will be latched until ~AA1 command is sent. **If the module status=4, all output command will be ignored.** Therefore the user should read the module status first to make sure that the module status is 0. If the module status is not 0, only ~AA1 command can clear the module status.

- **Syntax**: ~AA1[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: ~010(cr)	
response : !0104(cr)	module status=0x04 → host is down
command: @01DO00(cr)	
response : !(cr)	Output command is ignored
command: ~011(cr)	
response : !01(cr)	clear module status
command: ~010(cr)	
response : !0100(cr)	module status=0x00
command: @01DO00(cr)	
response : >(cr)	Output command is OK

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.6 ~AA2

7080/7080D

- **Description**: Read the status and timer value of host watchdog. The host watchdog timer is designed for host watchdog. When the host watchdog is enable, the host must send ~** command to all modules before the timer is up. When the ~** command is received, the host watchdog timer is reset and restart. Use ~AA3ETT to enable/disable/setting the host watchdog timer.

- **Syntax**: ~AA2[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AASTT[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0: host watchdog is disable
  S=1: host watchdog is enable
  TT=2-character HEX value, from 00 to FF, unit=0.1 second
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: ~012(cr)
  response : !01000(cr)

  Host watchdog timer of module 01 is disable

  command: ~022(cr)
  response : !0210A(cr)

  host watchdog timer of module 02 is enable and = 0.1*10 = 1 second.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.7 ~AA3ETT

7080/7080D

- **Description**: Enable/disable the timer value of host watchdog. The host watchdog timer is designed for software host watchdog. When the software host watchdog is enable, the host must send ~** command to all modules before the timer is up. When the ~** command is received, the host watchdog timer is reset and restart. Use ~AA2 to read the host watchdog status & value.

- **Syntax**: ~AA3ETT[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  E=0 is disable and 1 is enable
  TT=2-character HEX value, from 00 to FF, unit=0.1 second
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:
  command: ~013000(cr)
  response : !01(cr)

  disable host watchdog timer of module 01

  command: ~02310A(cr)
  response : !02(cr)

  host watchdog timer of module 02 is enable and = 0.1*10 = 1 second.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.8 ~AAAS

7080/7080D

- **Description**: Set counter alarm mode. Refer to Sec. 1.8.2 for more information.
- **Syntax**: ~AAAS[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  S=0 → alarm mode 0.
  1 → alarm mode 1.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: ~01A0(cr)
response : !01(cr)

Set alarm mode=0.

command: ~02A1(cr)
response : !02(cr)

Set alarm mode=1.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.9 ~AAO(name)

7080/7080D

- **Description**: Set module name.

- **Syntax**: ~AAO(name)[chk](cr)
  ~ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (name)=4-character/5-character module name
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $01M(cr)
  response : !017080(cr)
  command: ~01O8080(cr)
  response : !01(cr)

  Change module name from 7080 to 8080

  command: $01M(cr)
  response : !017080D(cr)
  command: ~01O8080D(cr)
  response : !01(cr)

  Change module name from 7080D to 8080D

Note: This command is designed for OEM/ODM user. The user can use it to change the module name for other purpose.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.10 $AA0H

7080/7080D

- **Description**: Read the min. input signal width at high level. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA0H[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=5-character decimal value for min. width at high level. The unit is uS and the range can be from 2 uS to 65535 uS.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $010H(cr)
response : !0100010(cr)

Min. width = **10** uS

command: $020H(cr)
response : !0201000(cr)

Min. width = **1000** uS = 1 mS

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.11 $AA0H(data)

7080/7080D

- **Description**: Set the min. input signal width at high level. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA0H(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=5-character decimal value for min. width at high level. The unit is uS and the range can be from 2 uS to 65535 uS.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $010H00010(cr)
response : !01(cr)

Min. width = **10** uS

command: $020H01000(cr)
response : !02(cr)

Min. width = **1000** uS = 1 mS

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.12 $AA0L

7080/7080D

- **Description**: Read the min. input signal width at low level. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA0L[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=5-character decimal value for min. width at low level. The unit is uS and the range can be from 2 uS to 65535 uS.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $010H(cr)
response : !0100020(cr)

Min. width=20 uS

command: $020H(cr)
response : !0202000(cr)

Min. width=2000 uS=2 mS

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.13 $AA0L(data)

7080/7080D

- **Description**: Set the min. input signal width at low level. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA0H(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=5-character decimal value for min. width at low level. The unit is uS and the range can be from 2 uS to 65535 uS.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $010H00020(cr)
response : !01(cr)

Min. width = **20** uS

command: $020H02000(cr)
response : !02(cr)

Min. width = **2000** uS = 2 mS

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.14 $AA1H

7080/7080D

- **Description**: Read the high trigger level of non-isolated input. Refer to Sec. 1.8.4 for more information.
- **Syntax**: $AA1H[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=2-character decimal value for high trigger level. The unit is 0.1 volt and the range can be from 0.0 to 5.0 volt.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $011H(cr)
response : !0124(cr)

High trigger level=2.4 volt

command: $021H(cr)
response : !0230(cr)

High trigger level=3.0 volt

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.15 $AA1H(data)

7080/7080D

- **Description**: Set the high trigger level of non-isolated input. Refer to Sec. 1.8.4 for more information.
- **Syntax**: $AA1H(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=2-character decimal value for high trigger level. The unit is 0.1 volt and the range can be from 0.0 to 5.0 volt.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $011H24(cr)
response : !01(cr)

High trigger level=2.4 volt

command: $021H30(cr)
response : !02(cr)

High trigger level=3.0 volt

- **Note**: default is 2.4V

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.16 $AA1L

7080/7080D

- **Description**: Read the Low trigger level of non-isolated input. Refer to Sec. 1.8.4 for more information.
- **Syntax**: $AA1L[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=2-character decimal value for low trigger level. The unit is 0.1 volt and the range can be from 0.0 to 5.0 volt.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $011L(cr)
response : !0108(cr)

Low trigger level=0.8 volt

command: $021L(cr)
response : !0210(cr)

Low trigger level=1.0 volt

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.17 $AA1L(data)

7080/7080D

- **Description**: Set the low trigger level of non-isolated input. Refer to Sec. 1.8.4 for more information.
- **Syntax**: $AA1L(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=2-character decimal value for low trigger level. The unit is 0.1 volt and the range can be from 0.0 to 5.0 volt.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $011L08(cr)
  response : !01(cr)

  Low trigger level=0.8 volt

  command: $021L10(cr)
  response : !02(cr)

  Low trigger level=1.0 volt

- **Note**: default is 0.8V

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.18 $AA2

7080/7080D

- **Description**: Read the configuration of module.
- **Syntax**: $AA2[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AATTCCFF[chk](cr),
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  TT, CC, FF: refer to Sec. 1.9
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: $012(cr)
  response : !01500600(cr)

  Address=01, counter, 9600 BPS, checksum disable

  command: $022(cr)
  response : !02510700(cr)

  Address=02, frequency, 19200 BPS, checksum disable

NOTE: If the user use %AANNTTCCFF command to change module configuration, the new configuration code will be stored into EEPROM immediately. The configuration code includes module address, module type, baud rate code, checksum enable/disable code, calibration code, power-on value and safe value. **The EEPROM data of I-7000 can be read infinite times and can be written about 100,000 times max.** Therefore the user should not change configuration code often for testing.
The $AA2 command is used to read EEPROM data only, therefore the user can send this command to I-7000 module infinitely.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.19 $AA3N

7080/7080D

- **Description**: Read the max. counter value.
- **Syntax**: $AA3N[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → channel-0 of counter or frequency
  1 → channel-1 of counter or frequency
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $0130(cr)
response : !010000FFFF(cr)

Counter-0 from preset value to FFFF

command: $0131(cr)
response : !01FFFFFFFF(cr)

Counter-1 from preset value to FFFFFFFF

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.20 $AA3N(data)

7080/7080D

- **Description**: Set the max. counter value.
- **Syntax**: $AA3N(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → channel-0 of counter or frequency
  1 → channel-1 of counter or frequency
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01300000FFFF(cr)
response : !01(cr)

Counter-0 from preset value to FFFF

command: $0131FFFFFFFF(cr)
response : !01(cr)

Counter-1 from preset value to FFFFFFFF

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.21 $AA4

7080/7080D

- **Description**: Read the status of digital filter. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA4[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → digital filter is disable
  1 → digital filter is enable
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $014(cr)
response : !010(cr)

Digital filter is disable.

command: $024(cr)
response : !021(cr)

Digital filter is enable.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.22 $AA4S

7080/7080D

- **Description**: Set the filter status. Refer to Sec. 1.8.5 for more information.
- **Syntax**: $AA4S[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  S=0 → digital filter is disable
  1 → digital filter is enable
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $0140(cr)
response : !01(cr)

Digital filter is disable.

command: $0241(cr)
response : !02(cr)

Digital filter is enable.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.23 $AA5N

7080/7080D

- **Description**: Read the counter status
- **Syntax**: $AA5N[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → counter 0
  1 → counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → counter is stop (disable)
  1 → counter is start (enable)
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $0150(cr)
response : !010(cr)

Counter 0 is stop now.

command: $0151(cr)
response : !011(cr)

Counter 1 is start now.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.24 $AA5NS

7080/7080D

- **Description**: Set the counter status
- **Syntax**: $AA5NS[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → counter 0
  1 → counter 1
  S=0 → stop counter
  1 → start counter
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $01500(cr)
  response : !01(cr)

  Stop the counter 0.

  command: $01511(cr)
  response : !01(cr)

  Start the counter 1.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.25 $AA6N

7080/7080D

- **Description**: Reset counter 0 or counter 1 to the preset value & clear the overflow flag. Refer to Sec. 1.8.7 for more information.
- **Syntax**: $AA6N[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → counter 0
  1 → counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: @01G0(cr)
response : !0100000000(cr)
command: $0160(cr)
response : !01(cr)

Preset value=0
Reset counter 0 to preset value 0

command: @01G1(cr)
response : !010000ABCD(cr)
command: $0161(cr)
response : !01(cr)

Preset value=0xABCD
Reset counter 1 to preset value 0xABCD

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.26 $AA7N

7080/7080D

- **Description**: Read the overflow flag of counter. The user can use $AA6S comand to reset counter & clear overflow flag.
- **Syntax**: $AA7N[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → counter 0
  1 → counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → no overflow
  1 → is overflow
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $0170(cr)
response : !011(cr)
command: $0160(cr)
response : !01(cr)

Counter 0 is overflow.

Clear the overflow flag.

command: $0171(cr)
response : !010(cr)

Counter 1 is OK.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.27 $AA8

7080D

- **Description**: Read the LED configuration.
- **Syntax**: $AA8[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → show counter/frequency channel 0
  1 → show counter/frequency channel 1
  2 → HOST control
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $018(cr) response : !010(cr)	LED show the value of channel 0.
command: $028(cr) response : !021(cr)	LED show the value of channel 1.
command: $038(cr) response : !032 (cr)	HOST control the LED display.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.28 $AA8V

7080D

- **Description**: Select LED Configuration.

- **Syntax**: $AA8V[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  V=0 → LED shows counter/frequency channel 0
  1 → LED show counter/frequency channel 1
  ….2 → HOST control LED
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $0181(cr)
  response : !01(cr)

  LED shows channel 1.

  command: $0282(cr)
  response : !02(cr)
  command: $029040.00(cr)
  response : !02(cr)

  HOST will control LED.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.29 $AA9(data)

7080D

- **Description**: Send data to LED display.

- **Syntax**: $AA9(data)[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)→ **5 decimal digit + 1 decimal point**
  max. = 99999.
  min. = 0.0000
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or
  communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $01999999.(cr)
  response : !01(cr)
  Show max. = 99999.

  command: $0290.0000(cr)
  response : !02(cr)
  Show min. = 0.0000.

  command: $03912.345(cr)
  response : !03(cr)
  Show display = 12.345

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.30 $AAA

7080/7080D

- **Description**: Read gate control mode. Refer to Sec. 1.8.6 for more information.
- **Syntax**: $AAA[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAG[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  G=0 → gate is low active
  1 → gate is high active
  2 → gate is disable
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01A(cr)
response : !010(cr)

Gate is low active.

command: $02A(cr)
response : !021(cr)

Gate is high active.

command: $03A(cr)
response : !032 (cr)

Gate is disable (always active).

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.31 $AAAG

7080/7080D

- **Description**: Set gate control mode. Refer to Sec. 1.8.6 for more information.
- **Syntax**: $AAAG[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  G=0 → gate is low active
  1 → gate is high active
  2 → gate is disable
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01A0(cr)
response : !01(cr)

Gate is low active.

command: $02A1(cr)
response : !02(cr)

Gate is high active.

command: $03A2(cr)
response : !03(cr)

Gate is disable (always active).

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.32 $AAB

7080/7080D

- **Description**: Read input mode. Refer to Sec. 1.8.1 for more information.
- **Syntax**: $AAB[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → channel 0 is non-isolated, channel 1 is non-isolated.
  1 → channel 0 is isolated, channel 1 is isolated.
  2 → channel 0 is non-isolated, channel 1 is isolated.
  3 → channel 0 is isolated, channel 1 is non-isolated.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01B(cr)
response : !010(cr)

Counter/frequency channel 0 is non-isolated, channel 1 is non-isolated.

command: $02B(cr)
response : !021(cr)

Counter/frequency channel 0 is isolated, channel 1 is isolated.

command: $03B(cr)
response : !032(cr)

Counter/frequency channel 0 is non-isolated, channel 1 is isolated.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.33 $AABS

7080/7080D

- **Description**: Set input mode. Refer to Sec. 1.8.1 for more information.
- **Syntax**: $AABS[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  S=0 → channel 0 is non-isolated, channel 1 is non-isolated.
  1 → channel 0 is isolated, channel 1 is isolated.
  2 → channel 0 is non-isolated, channel 1 is isolated.
  3 → channel 0 is isolated, channel 1 is non-isolated.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01B0(cr)
response : !01(cr)

Counter/frequency channel 0 is non-isolated, channel 1 is non-isolated.

command: $02B1(cr)
response : !02(cr)

Counter/frequency channel 0 is isolated, channel 1 is isolated.

command: $03B2(cr)
response : !03(cr)

Counter/frequency channel 0 is non-isolated, channel 1 is isolated.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.34 $AAF

7080/7080D

- **Description**: Read the version number of firmware.

- **Syntax**: $AAF[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  data=5-character for version number
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $01F(cr)
  response : !01A2.0(cr)

  Ver. A2.0

  command: $02F(cr)
  response : !02A3.0(cr)

  Ver. A3.0

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.35 $AAI

7080/7080D

- **Description**: Read the value of *INIT pin.
- **Syntax**: $AAI[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AAS[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  S=0 → INIT* pin is connected to GND pin
  1 → INIT* pin is open
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

command: $01I(cr)
response : !010(cr)

INIT* pin is connected to GND pin.

command: $02I(cr)
response : !021(cr)

INIT* pin is open.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.36 $AAM

7080/7080D

- **Description**: Read the module name.

- **Syntax**: $AAM[chk](cr)
  $ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  data=4-character for module name
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: $01M(cr)
  response : !017080(cr)

  Module name of 01 is 7080

  command: $02M(cr)
  response : !027080D(cr)

  Module name of 02 is 7080D

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.37 @AADI

7080/7080D

- **Description**: Read the status of D/O & alarm. Refer to Sec. 2.8 for more information.
- **Syntax**: @AADI[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AAS0D00[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  D=0 → D/O0=D/O1=OFF
  =1 → D/O0=ON, D/O1=OFF
  =2 → D/O0=OFF, D/O1=ON
  =3 → D/O0=D/O1=ON

Alarm mode 0

S=0 → counter 0 alarm=disable, counter 1 alarm=disable
=1 → counter 0 alarm=enable, counter 1 alarm=disable
=2 → counter 0 alarm=disable, counter 1 alarm=enable
=3 → counter 0 alarm=enable, counter 1 alarm=enable

Alarm mode 1

S=0 → counter 0 alarm=disable
=1 → counter 0 alarm=enable & MOMENTARY mode
=2 → counter 0 alarm=enable & LATCH mode

[chk]=2-character checksum, if checksum disable → no [chk]
(cr)=0x0D

- **Example**:

command: @01DI(cr)
response : !0100000(cr)

Alarm disable.
D/O0=D/O1=OFF

command: @02DI(cr)
response : !0230100(cr)

Alarm enable. D/O0=ON.
D/O1=OFF

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.38 @AADO0D

7080/7080D

- **Description**: Set digital output.
- **Syntax**: @AADO0D[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  D=0 → D/O0=D/O1=OFF
  =1 → D/O0=ON, D/O1=OFF
  =2 → D/O0=OFF, D/O1=ON
  =3 → D/O0=D/O1=ON
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  alarm is enable → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:

command: @01DO00(cr)
response : !01(cr)

Turn all D/O OFF.

command: @02DO01(cr)
response : !02(cr)

Turn D/O 0 ON.
Turn D/O 1 OFF.

NOTE: if the alarm is enable, the D/O 0 & D/O 1 will be always controlled by module. Therefore the following D/O commands will be ignored.

- **power-on value is changed to hi/lo condition immediately**
- **the @AADO0D command is ignored.**

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.39 @AAEAN

7080/7080D

- **Description**: Enable counter alarm(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.
- **Syntax**: @AAEAN[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → enable counter 0
  1 → enable counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D

- **Example**:

  command: @01EA0(cr)
  response : !01(cr)

  Enable counter 0.

  command: @01EA1(cr)
  response : !02(cr)

  Enable counter 1.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.40 @AAEAT

7080/7080D

- **Description**: Enable counter alarm(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AAEAT[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  T=M → momentary alarm, T=L → latch alarm
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:

command: @01EAL(cr)
response : !01(cr)

Latch alarm.

command: @02EAM(cr)
response : !02(cr)

Momentary alarm.

NOTE: if the alarm is enable, the D/O 0 & D/O 1 will be always controlled by module. Therefore the following D/O commands will be ignored.

- **power-on value is changed to hi/lo condition immediately**
- **the @AADO0D command is ignored.**

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.41 @AACA

7080/7080D

- **Description**: Clear latch alarm(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AACA[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:

command: @01CA(cr)
response : !01(cr)

Clear latch alarm.

command: @02CA(cr)
response : !02(cr)

Clear latch alarm.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.42 @AADA

7080/7080D

- **Description**: Disable alarm(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AADA[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01DA(cr)
  response : !01(cr)

  Disable alarm.

  command: @02DA(cr)
  response : !02(cr)

  Disable alarm.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.43 @AADAN

7080/7080D

- **Description**: Disable alarm(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AADAN[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → disable counter 0
  1 → disable counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:

command: @01DA0(cr)
response : !01(cr)

Disable counter 0 alarm.

command: @02DA1(cr)
response : !02(cr)

Disable counter 1 alarm.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.44 @AAGN

7080/7080D

- **Description**: Read the preset value of counter. The $AA6 command can reset counter to the preset value. Refer to Sec. 1.8.7 for more information.

- **Syntax**: @AAGN[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  N=0 → read counter 0
  1 → read counter 1
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01G0(cr)
  response : !010000FFFF(cr)

  The preset value of counter 0 is 0000FFFF.

  command: @02G1(cr)
  response : !0200000000(cr)

  The preset value of counter 1 is 00000000.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.45 @AAPN(data)

7080/7080D

- **Description**: Set the preset value of counter. The $AA6 command can reset counter to preset value. Refer to Sec. 1.8.7 for more information.

- **Syntax**: @AAPN(data)[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01P0FFFF0000(cr)
  response : !01(cr)

  The preset value of counter 0 is FFFF0000.

  command: @02P10000FFFF(cr)
  response : !02(cr)

  The preset value of counter 1 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.46 @AAPA(data)

7080/7080D

- **Description**: Set alarm limit of counter 0(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AAPA(data)[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01PAFFFF0000(cr)
  response : !01(cr)

  The alarm limit of counter-0 is FFFF0000.

  command: @02PA0000FFFF(cr)
  response : !02(cr)

  The alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.47 @AAPA(data)

7080/7080D

- **Description**: Set Hi-alarm limit of counter 0(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AAPA(data)[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01PAFFFF0000(cr)
  response : !01(cr)

  The Hi-alarm limit of counter 0 is FFFF0000.

  command: @02PA0000FFFF(cr)
  response : !02(cr)

  The Hi-alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.48 @AASA(data)

7080/7080D

- **Description**: Set alarm limit of counter-1(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AASA(data)[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01SAFFFF0000(cr)
  response : !01(cr)
  The alarm limit of counter 1 is FFFF0000.

  command: @02SA0000FFFF(cr)
  response : !02(cr)
  The alarm limit of counter 1 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.49 @AASA(data)

7080/7080D

- **Description**: Set Hi-Hi-alarm limit of counter 0(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AASA(data)[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01SAFFFF0000(cr)
  response : !01(cr)

  The Hi-Hi-alarm limit of counter 0 is FFFF0000.

  command: @02SA0000FFFF(cr)
  response : !02(cr)

  The Hi-Hi-alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.50 @AARP

7080/7080D

- **Description**: Read alarm limit of counter 0(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AARP[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01RP(cr)
  response : !01FFFF0000(cr)

  The alarm limit of counter 0 is FFFF0000.

  command: @02RP(cr)
  response : !020000FFFF(cr)

  The alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.51 @AARP

7080/7080D

- **Description**: Read Hi-alarm limit of counter 0(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AARP[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01RP(cr)
  response : !01FFFF0000(cr)

  The Hi-alarm limit of counter 0 is FFFF0000.

  command: @02RP(cr)
  response : !020000FFFF(cr)

  The Hi-alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.52 @AARA

7080/7080D

- **Description**: Read alarm limit of counter-1(for alarm-mode 0). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AARA[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01RA(cr)
  response : !01FFFF0000(cr)

  The alarm limit of counter 1 is FFFF0000.

  command: @02RA(cr)
  response : !020000FFFF(cr)

  The alarm limit of counter 1 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

2.53 @AARP

7080/7080D

- **Description**: Read Hi-Hi-alarm limit of counter 0(for alarm-mode 1). Refer to Sec. 1.8.2 for more information.

- **Syntax**: @AARP[chk](cr)
  @ is a delimiter character
  AA=2-character HEX module address, from 00 to FF
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Response**: valid command → !AA(data)[chk](cr)
  invalid command → ?AA[chk](cr)
  no response → syntax error or communication error or address error
  ! is a delimiter character indicating a valid command
  ? is a delimiter character indicating a invalid command
  AA=2-character HEX module address
  (data)=8-character HEX value.
  [chk]=2-character checksum, if checksum disable → no [chk]
  (cr)=0x0D
- **Example**:
  command: @01RP(cr)
  response : !01FFFF0000(cr)

  The Hi-Hi-alarm limit of counter 0 is FFFF0000.

  command: @02RP(cr)
  response : !020000FFFF(cr)

  The Hi-Hi-alarm limit of counter 0 is 0000FFFF.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3. Operations Principle & Application Notes

3.1 INIT*_pin Operation Principle

All I-7000 modules contain an EEPROM to store configuration information. Therefore the user is difficult to find out the status of the I-7000 modules. The user can connect the INIT*_pin to GND_pin and power on the module. The I-7000 modules will **go to the factory default setting without changing the EEPROM data.** The factory default setting is given as following:

address	= 00
baud rate	= 9600
checksum	= DISABLE
data format	= 1 start + 8 data bits + 1 stop bit

If the user disconnect the INIT*_pin and GND_pin, the I_7000 module will be auto configured according to the EEPROM data. The user is easy to find the EEPROM configuration data in the default setting. The steps are shown as following:

Step 1: power off and connect INIT*_pin to GND_pin
Step 2: power on
Step 3: send command string **$002[0x0D]** to the module, the module will return back the EEPROM data.
Step 4: record the EEPROM data of this I-7000 module
Step 5: power off and disconnect INIT*_pin and GND_pin
Step 6: power on

Refer to "I-7000 Bus Converter User Manual" Sec. 5.1 for more information.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.2 D/O Operation Principle

(1) Refer to Sec. 1.8.3 for more information.

(2) The D/O output of I-7080 & I-7080D modules will be turn OFF after first power on.

(3) The D/O output will be changed to the desired state if the "@AADO" command is received. Then all these D/O will keep in the same states until next "@AADO" command.

(4) If the host watchdog is active, all the D/O will not change and the module status is set to 04. If the host computer send out "@AADO" to those modules now, those modules will ignore this command and return "!" as warning information. The host can use "~AA1" command to clear the module status to 0, then the I-7080 & I-7080D module will accept the "@AADO" again.

(5) If the D/O output is configured as alarm output, the module will control the ON/OFF state automatically. Therefore the "@AADO" command will be ignored in this condition.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000

3.3 New Features of 7080B

Difference between 7080 & 7080B

	7080	7080B
type	50 or 51	50, 51 or 52
default type	50, counter	52, backup counter
Firmware Version	A1.9	B1.0
Other commands	Same	
Windows driver & utility	Same	
Pins assignment	Same	
@AAPN(data) in Type 50	Same	
@AAPN(data) in Type 51	Same	
@AAPN(data) in Type 52	N/A	Set current counter value & preset value in EEPROM

Note:

1. The 7080B will 100% as same as 7080 if the type is set to 50 or 51.

2. Assume 7080/7080B is set to type 50, @AAPN (data) command will set the preset value in EEPROM, but the current counter is no changed.

3. Assume 7080B is set to type 52, @AAPN (data) command will set the current counter value & preset value in EEPROM at the same time.

LRI Distribuída no Brasil pela LRI | vendas@lri.com.br | 51 2129-3000